

DOCUMENT RESUME

ED 433 686

EF 005 603

AUTHOR Floyd, David B.; Parker, Danny S.; McIlvaine, Janet E. R.; Sherwin, John R.
TITLE Energy Efficiency Technology Demonstration Project for Florida Educational Facilities: Occupancy Sensors.
INSTITUTION Florida Solar Energy Center, Cape Canaveral.
SPONS AGENCY Florida State Dept. of Education, Tallahassee. Office of Educational Facilities.
REPORT NO FSEC-CR-867-95
PUB DATE 1995-12-00
NOTE 28p.
AVAILABLE FROM Florida Solar Energy Center, 1679 Clearlake Rd., Cocoa, FL 32922-5703.
PUB TYPE Reports - Research (143)
EDRS PRICE MF01/PC02 Plus Postage.
DESCRIPTORS Climate Control; Comparative Analysis; *Educational Facilities Improvement; Electricity; Elementary Education; Elementary Schools; *Energy Management; *Lighting; Public Schools
IDENTIFIERS Cost Containment; Florida; *Occupancy Sensors

ABSTRACT

A Florida study replaced conventional light switches with passive infrared or ultrasonic sensing systems to control classroom lighting in an elementary school to determine the performance of such controls in saving energy. A before-and-after monitoring protocol was used for 33 classrooms and 7 offices in which electrical demand data were collected. Data comparing pre- and post-retrofit periods show sensors achieved an average of 10 percent savings with greater reductions to total energy due to reduced load on the air conditioning system. It is noted that the school already had considerable energy efficient use of lighting with a T8 system, so the benefits are considered to be the minimum a facility can expect to achieve through sensor use. Including costs of installation and commissioning, the payback of the occupancy sensor retrofit was 5 years with a 21 percent simple rate of return from the investment. An appendix provides an overview of occupancy sensor technology. (Contains 14 references.) (GR)

* Reproductions supplied by EDRS are the best that can be made *
* from the original document. *

Energy Efficiency Technology Demonstration Project for Florida Educational Facilities: Occupancy Sensors

FSEC-CR-867-95
December 1995

Submitted to

Florida Department of Education
Office of Educational Facilities
Room 1014, Florida Education Center
325 West Gaines St.
Tallahassee, FL 32399

U.S. DEPARTMENT OF EDUCATION
Office of Educational Research and Improvement
EDUCATIONAL RESOURCES INFORMATION
CENTER (ERIC)

This document has been reproduced as received from the person or organization originating it.

Minor changes have been made to improve reproduction quality.

Points of view or opinions stated in this document do not necessarily represent official OERI position or policy.

Prepared by

David B. Floyd
Danny S. Parker
Janet E.R. McIlvaine
John R. Sherwin

Florida Solar Energy Center
1679 Clearlake Rd.
Cocoa, FL 32922-5703

PERMISSION TO REPRODUCE AND
DISSEMINATE THIS MATERIAL HAS
BEEN GRANTED BY

Mark Yerkes

TO THE EDUCATIONAL RESOURCES
INFORMATION CENTER (ERIC)

1

EF 005 603

BEST COPY AVAILABLE

Table of Contents

	Executive Summary.....	i
I.	Introduction.....	1
II.	Lighting.....	1
III.	Background.....	3
IV.	Site Description and Monitoring Plan.....	4
V.	Instrumentation.....	7
VI.	Occupancy Sensor Installation.....	10
VII.	Data Analysis.....	10
VIII.	Economic Analysis.....	15
IX.	Conclusions.....	16
X.	Follow Up.....	17
XI.	Acknowledgements.....	17
XII.	Contacts.....	17
XIII.	References.....	19

Appendix A: Overview of Occupancy Sensor Technology and Manufacturer Literature

Executive Summary

In 1995 the Florida Department of Education and the Florida Solar Energy Center jointly sponsored a test of occupancy sensors used to control lighting in a Florida school. Occupancy sensors replace conventional light switches and use passive infrared or ultrasonic sensing to control lighting in classroom and other spaces. The test was intended to demonstrate the performance of such controls in saving energy in Florida educational facilities.

The evaluation was performed at Northwest Elementary School in Pasco County on Florida's west central coast. A before and after monitoring protocol was utilized for the study which saw lighting circuits for 33 classrooms and seven offices sub-metered. Fifteen minute electrical demand data were taken for six months prior to the lighting controls being modified to accommodate occupancy sensors. Recorded data in the baseline period showed that lighting made up approximately 24% of total electrical energy use at the school.

The test building was unusual in that it contained a modern efficient lighting system with T8 fluorescent lamps and electronic ballasts. More importantly, the Pasco County features one of the most aggressive energy management programs of any district school board in the state. Even before installation of the occupancy sensors, lighting was effectively controlled by facility staff so as to prevent waste. Given these factors, it was expected that the evaluation in Northwest Elementary would provide insight into the *minimum* savings that could be expected from the technology in Florida school.

A total of 46 occupancy sensors were installed in August, 1995 and then carefully adjusted in terms of location, time delay and sensing sensitivity over the following two weeks. Data were taken in a post retrofit configuration for five months. The analysis of the comparative pre and post retrofit periods showed that the occupancy sensors saved an average of 10% of the pre-retrofit lighting energy (97 kWh/Day) with greater reductions to total energy due to reduced load on the air conditioning system. Most of the savings occurred during the evening hours so that monthly peak electrical demand was little affected.

Including costs of installation and commissioning, the payback of the occupancy sensor retrofit was five years with a 21% simple rate of return from the investment. This performance is considered excellent given the fact that the building already had an efficient lighting system which was responsibly controlled prior to the occupancy sensor installation. The project results indicate that with proper installation and adjustment (which was found to be critically important to user acceptance) occupancy sensor technology will provide economically attractive returns either in new or existing Florida educational facilities.

Energy Efficiency Technology Demonstration Project for Florida Educational Facilities: Occupancy Sensors

D. B. Floyd, D. S. Parker, J. E. R. McIlvaine, and J. R. Sherwin

Florida Solar Energy Center
1679 Clearlake Road.
Cocoa, FL 32922-5703

I. Introduction

In 1993, the Florida Department of Education (FDOE) and the Florida Solar Energy Center (FSEC) began an energy efficiency campaign for Florida's schools. FDOE funded FSEC to produce a comprehensive analysis of energy efficiency options for *new* educational facilities. The findings of the study were compiled in a training manual and presented at three workshops in the Spring of 1995. However, during the presentations of the research findings to the Florida Educational Facilities Planners Association (FEFPA) many attendees requested information on the performance and economics of *retrofit* energy efficiency measures. Furthermore, a number of energy-efficiency technologies were identified whose savings were difficult to quantify. FDOE and FSEC then planned to meet this need by staging a series of research-demonstration projects to quantify performance in operating schools.

For the first technology demonstration, FSEC chose to study occupancy sensors, primarily because little performance data were available for this technology. Occupancy sensors replace standard light switches and turn off classroom lighting when students and teachers vacate spaces for a given period of time. Since savings are heavily influenced by occupants and their behavior, laboratory studies are impossible.

A Pasco County school, Northwest Elementary, was selected for the project in the Fall of 1994. The study was intended to provide information to measure the effectiveness of occupancy sensors in reducing two loads:

- *Lighting energy consumption, and*
- *Total energy consumption*

Instrumentation was installed and data collection began in February of 1995. Data in the pre-retrofit baseline condition was collected up through August 7, 1995. The experiment was concluded in December of 1995 after a post retrofit monitoring period was completed. The results of the study will be presented to the educational facilities design community in its 1996 meetings.

Energy End-Use in Florida Schools
Source: SRC, 1992

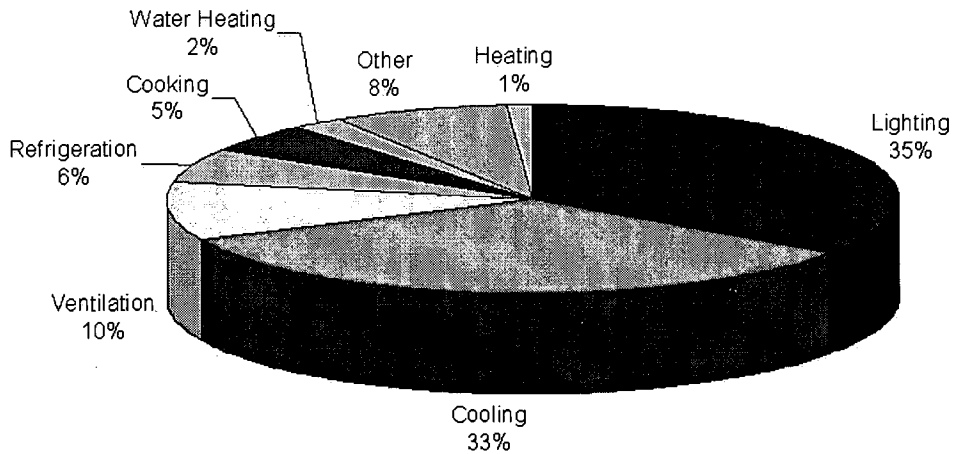


Figure 1. Energy end uses in Florida schools.

Peak Sensible Cooling Loads
Prototypical FL School

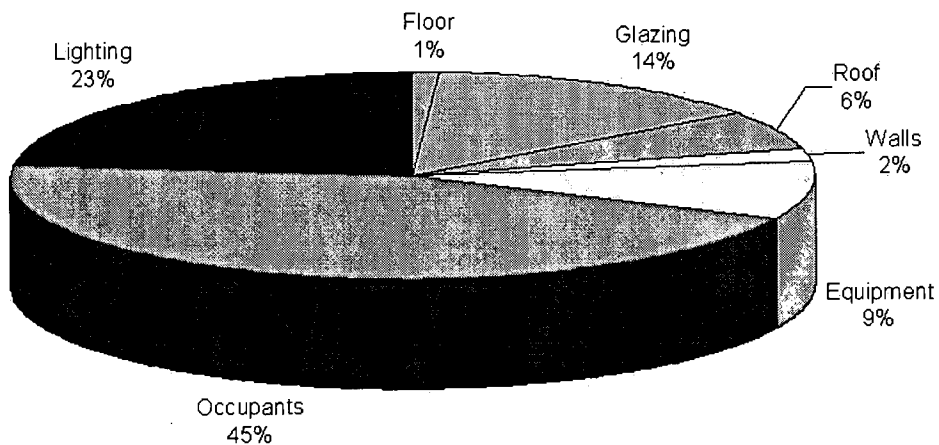


Figure 2. Components of the peak HVAC load in typical new educational facilities predicted by the hourly simulation DOE 2.1D.

II. Lighting Energy Use in Florida Schools

Electricity for interior lighting systems makes up about a third of the energy used in Florida schools as seen in Figure 1. Further, internal heat produced by interior lighting contributes about 23% of the peak sensible air conditioning load as shown in Figure 2. Thus, lighting consumption indirectly increases facility energy demand by adding to the space cooling loads.

Schools have two primary options for reducing the lighting energy load:

- *Increase the efficiency of the lighting system, or*
- *Reduce the operating hours of the system*

One strategy employs more efficient lamps, ballasts, and fixtures to reduce the energy required to provide the desired level of work place illuminance. The second method employs lighting controls to reduce the amount of time the system is powered. Conventional controls include time clocks that turn lights off after hours and master switches which use "sweep control" to turn off a zone or building. Occupancy sensors match the electrical lighting to the space conditions based on space use.

While more efficient systems, such as T8 lamps with electronic ballasts, have repeatedly produced significant savings, objective data on the energy reduction from occupancy sensors are more elusive. Savings critically depend on how occupants use a space. Therefore, savings for schools hinge on a critical question: How often and how long are school spaces currently unoccupied with the lights unintentionally left on?

III. Background

The research team's decision to study occupancy sensors was based on the interest expressed by Florida's school design community during the May 1995 workshop series. More debate surrounded occupancy sensors than any of the energy conservation measures (ECMs) presented. Discussion elicited three fundamental issues:

- *Product quality*
- *Cost/benefit*
- *Reliability.*

As an inexpensive option and potential retrofit measure, occupancy sensors appeal to the school building industry. On the other hand, problems with early installations have damaged the reputation of the technology for some users (Energy User News, 1991).¹ The devices themselves are of two primary types: passive infrared and ultrasonic as described in Appendix A.

Reports suggested that older products failed regularly or turned off lights on occupied classrooms, requiring extra maintenance and/or causing frustration for school personnel. While

¹ Each sensor costs about \$120 when purchased and installed in quantity.

many reported these type of problems, others expressed a positive opinion of occupancy sensors. These reports typically came from persons with more recent experience, suggesting that the reliability of the technology had improved.

Even those workshop attendees who viewed the sensors positively, however, reported problems with performance. These problems include "false positives" and "false negatives"; triggering the lights on or off at inappropriate times. It was hoped that FSEC's assessment would provide objective performance data on occupancy sensors for Florida's school design and management community and help resolve these questions.

Some educational facilities planners questioned the economics of occupancy sensors. They argued that classrooms, which make up the bulk of primary and secondary school facilities, do not remain unoccupied for long periods and that most teachers diligently turn lights off upon leaving rooms. Many expressed the opinion that occupancy sensors would be most appropriate for intermittently used spaces, such as break and copy rooms. However, without empirical evidence, the performance and economics of the technology remain the subject of speculation.

Generally, lighting energy reductions from occupancy sensors will roughly follow room vacancy rates. Savings will be, of course, modified by occupant responsiveness in turning off lights in unoccupied areas. Measured lighting energy savings from occupancy sensor installations are surprisingly sparse. Both the Electric Power Research Institute and ASHRAE estimates an average 30% savings from this technology in generic assessments for commercial buildings (EPRI, 1993; ASHRAE, 1989). These data are generally supported by a utility evaluation performed by Consolidated Edison which found a 30% reduction in average lighting demand for its projects which installed occupancy sensors (Audin, 1993).

Measured data from case studies also indicates good performance from occupancy sensor installations. A retrofit of an office building with passive infrared occupancy sensor controls in South Australia yielded a 40% reduction in lighting energy use with a simple payback of two years (Caddet, 1995). Also, several case studies of occupancy sensor installations show savings of 25 - 75% in variety of spaces (EPRI, 1994). The Florida Solar Energy Center has conducted two previous occupancy sensor studies. One studied savings for facility restrooms, while the other studied a small office building. Savings in the restrooms exceeded expectations at greater than 60% while the average savings in a small office building were approximately 15% (BDAC Energy Files, 1995). The reductions were manifested primarily during the lunch hour and after hours. Finally, a detailed study of occupancy sensors used in a national laboratory found a 31% average lighting energy reduction (Richman, et al., 1995) with savings strongly affected both by space type and time delay setting.

Performance data specific to educational facilities is more limited. Occupancy sensor manufacturers often claim a 40 - 50% savings in classroom energy use (Novitas, 1993, Watt-stopper, 1994). A pertinent case study at the University of New Hampshire showed a reduction in classroom lighting system on-time of some 3 hours per day (EPRI, 1994). However, prior to this study no evaluation had examined the savings in a Florida classroom environment, and no information existed on possible impacts on monthly demand.

IV. Site Description and Monitoring Plan

Representatives from the District School Board of Pasco County School approached FSEC at the Summer 1994 meeting of the Florida Educational Facilities Planners. The school's representatives expressed interest in participating in a field study. Pasco County's Energy Management division funds energy retrofits out of a revolving fund initiated by the school board and probably represents the most progressive of such programs in the state.

Northwest Elementary school, on Florida's west coast near Hudson, was chosen for the demonstration. The school facility is comprised of one main building, a kindergarten annex, and several portable classroom units. The 58,000 ft² main building, which received the occupancy sensor installation includes 33 classrooms, seven offices and a cafeteria. The main building is shown as Figure 3; one of the wall mounted occupancy sensors is seen in Figure 4.

There are some 200 school days per year, not including holidays, weekends and summer recess. The school day extends from 7:00 AM - 3:45 PM, although office and janitorial activities often extend beyond the formal school day schedule.

The occupancy sensors and monitoring equipment were obtained by FSEC and the installation labor were provided by *Withlacoochee River Electric Cooperative*. FSEC technicians audited the school on December 21, 1994 and subsequently drew up a plan for instrumentation to monitor its energy use. A survey of the school's electrical system revealed eleven circuits of HVAC, five lighting circuits, two circuits of portable classrooms and two circuits supplying a kindergarten addition.

Occupancy sensors emerged as the choice for improved lighting efficiency at the school as it has few windows, but a modern efficient lighting system. A combination of two lamp T10/magnetic ballast and T8/electronic ballast fixtures illuminate each space.

The audit team found that monitoring the portables and the kindergarten suite was not feasible since separating the lighting load for these spaces was cost prohibitive. The main building, comprised of classroom pods, administrative spaces, a media center, and a cafeteria, became the subject of the study. After reviewing the audit details, an equipment list was established and the following metering equipment was obtained.



Figure 3. Exterior of Northwest Elementary School in Pasco County, Florida. The school was the site of an energy saving technology demonstration by the Florida Department of Education. The test was to determine if occupancy sensors can save lighting energy.

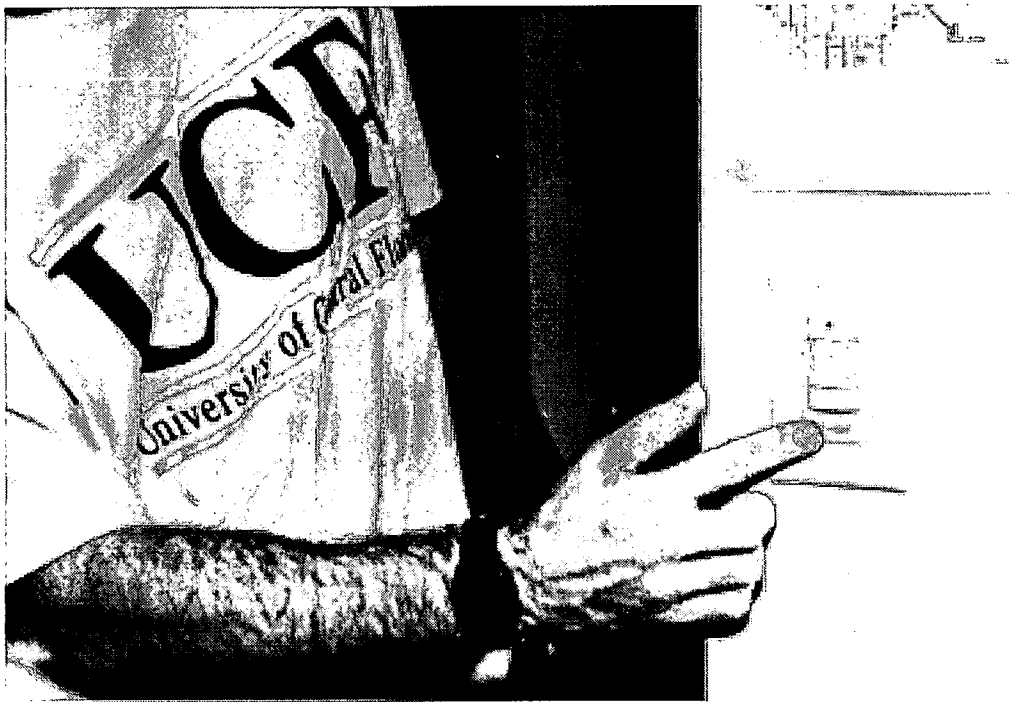


Figure 4. An FSEC engineer demonstrates the operation of wall mount occupancy sensor. Some 46 sensors were installed at the school for the test project. Each electronically detects the motion of students and teachers through infrared-sensing and automatically turns off lights when no motion is detected over a given period of time.

Table 1
Installed Metering Equipment

Project Monitoring Equipment	Cost
Instrumentation	
CR10 Multi-channel Datalogger	\$ 1,000
SW8A Switch Closure Board	\$ 150
Modem/Power Supply	\$ 100
Enclosure	\$ 200
Miscellaneous	<u>\$ 300</u>
Subtotal	\$1,750
Transducers	
100 amp, 3 phase	\$ 500
100 amp, 3 phase	\$ 500
100 amp, 3 phase	\$ 500
100 amp, 3 phase	\$ 500
100 amp, 3 phase	\$ 500
100 amp, 3 phase	\$ 500
50 amp, 1 phase	\$ 325
50 amp, 1 phase	<u>\$ 325</u>
Subtotal	\$3,150
Total	\$4,900

The Energy Manager for the school district, agreed to provide a pulse count meter to measure total electrical consumption and a dedicated telephone line for daily retrieval of the monitored data. All equipment was then obtained, configured and calibrated.

V. Instrumentation

FSEC instrumented the facility on February 25, 1995 as shown in Figures 5 and 6. The data acquisition system measures various parameters to assess the savings associated with the retrofit. Monitored meteorological conditions were limited to ambient air temperature because the retrofit would not likely be affected by weather conditions. Table 2 lists the monitored parameters and the associated engineering units.

Table 2
Occupancy Sensor Field Test Measurement Parameters

Parameter	Units	Number of Sensors
Ambient air temperature	°F	1
Lighting electrical consumption	kWh	6
Portables electrical consumption	kWh	2
Total electrical consumption	kWh	1

Temperature measurements were obtained using type-T thermocouples. A vented enclosure shielded the ambient air temperature sensor from solar radiation. *Ohio Semitronics* Watt-hour transducers with split core current transformers measured lighting electricity use and are accurate to within 2% of their full-range wattage (RMS).

Analog and pulse outputs from the instrumentation were converted to digital format and stored using a *Campbell Scientific* model *CR10* datalogger. Measurements are made at 0.2 Hz and averaged and stored every 15 minutes. Electrical power was totaled over 15 minute intervals. Data were transferred from the datalogger via telephone modem to FSEC's *VAX 4000* nightly. Once processed and archived, the daily data for the school were automatically plotted.

Plots were inspected each morning by an FSEC project engineer to ensure reliable data collection and proper metering. Lighting energy is lowered by a reduction of lighting hours, while total energy is conserved by reduction of direct lighting energy as well as heat produced by lights as a component of the heating, ventilation, and air conditioning (HVAC) load. These two parameters, total power and lighting power, appear on FSEC's daily graphs of measured data. An example of the daily data, for December 1st, 1995 is shown in Figure 7.

FSEC subtracted the energy use of the excluded kindergarten suite and portable classrooms from the total power to obtain the energy use of the main building:

$$\text{MB kWh} = \text{Total} - \text{Portables} - \text{Kindergarten}$$

Where:

MB kWh = Main Building electricity consumption (kWh)

Portables = Portables electrical consumption (kWh)

Kindergarten = Kindergarten suite electrical consumption (kWh)

The retrofit was scheduled for August 1995 to allow a roof repair and modifications to pod classrooms in the early summer, but to secure the retrofit by the start of the 1995-1996 school year.



Figure 5. FSEC engineer, John Sherwin, installs an electric power transducer as part of the instrumentation at Northwest Elementary School on February 25, 1994.


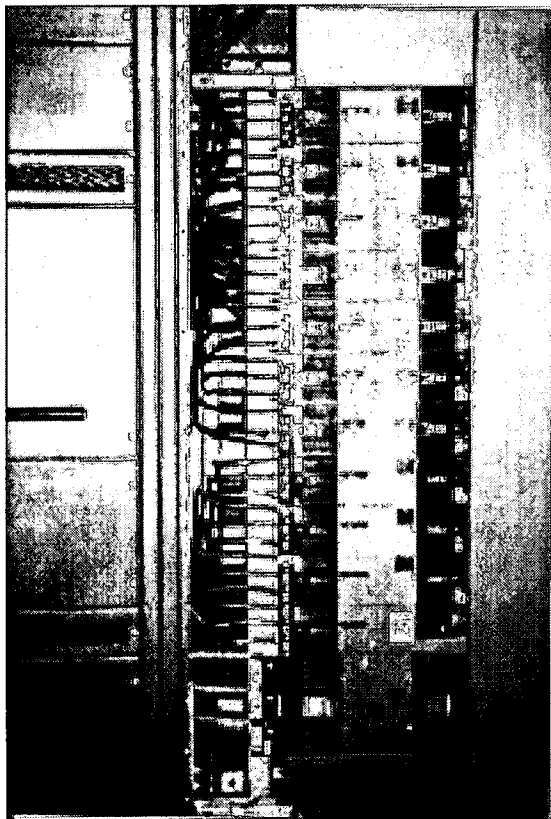


Figure 6. Lighting electrical panel from which measurements were taken. Split core current transducers were fitted around the appropriate legs to measure lighting power in the main building.

BEST COPY AVAILABLE

Northwest Elementary Test Site (PCO)

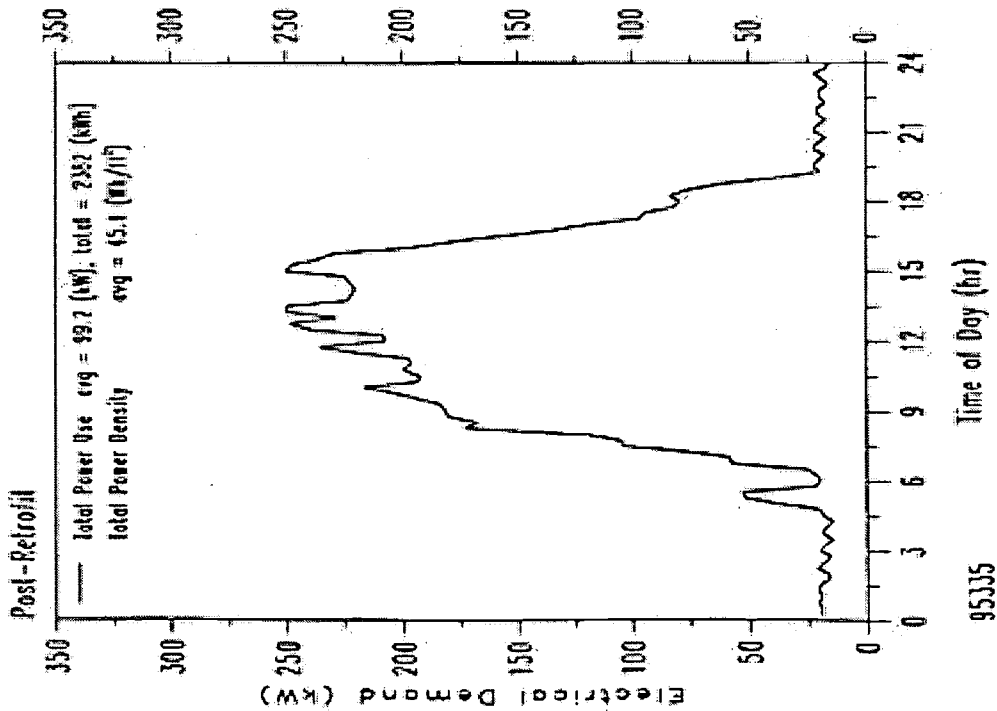

Northwest Elementary Test Site (PCO)

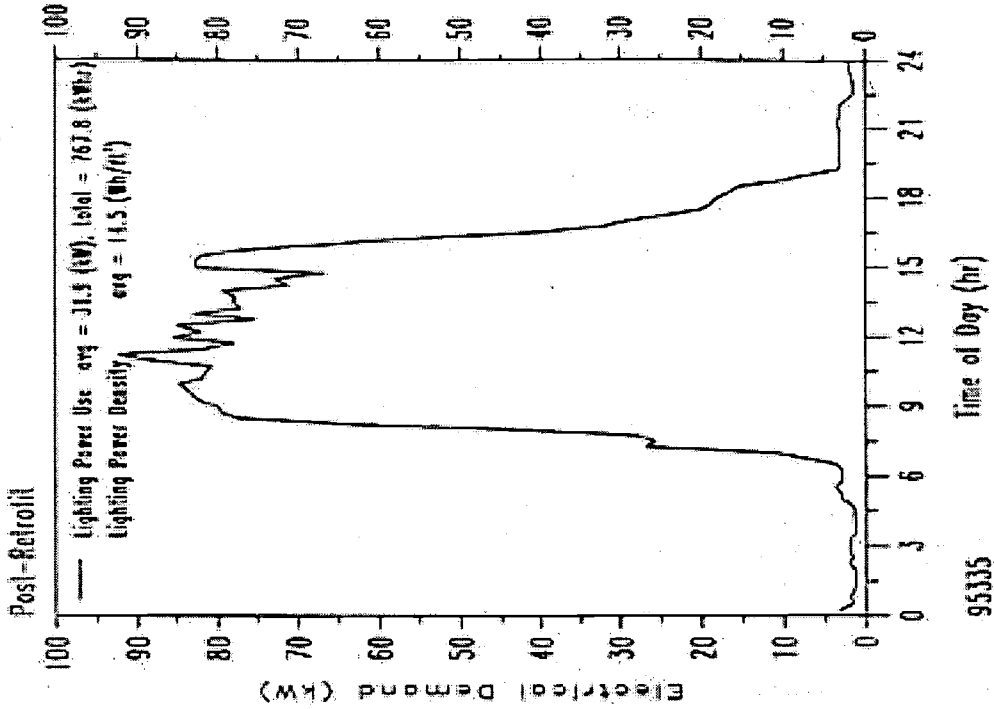


Figure 7. Plot of total lighting power energy demand on Friday, December 1, 1995.

VI. Occupancy Sensor Installation

A total of 46 passive infrared (PIR) occupancy sensors were installed at Northwest Elementary from August 7, 1995 to August 15, 1995. The installation was performed by a team of two electricians, a Research Engineer from the Florida Solar Energy Center and the Energy Coordinator from Pasco County. Approximately 33 classrooms, seven offices, and a cafeteria were equipped with occupancy sensors, as shown in Figure 8. Several offices had the wall switches replaced with automatic wall switches. The remainder of the spaces (classrooms, cafeteria, and larger offices) received ceiling mounted sensors. The broad coverage of the ceiling mounted sensor minimized the need for multiple occupancy sensors in all but five areas. The classroom lighting layout and occupancy sensor installation and placement is illustrated in Figures 9 and 10.

Manufacturer literature for the selected sensors is attached in Appendix A with a brief description of occupancy sensor technology. Several other resources exist describing appropriate application of occupancy sensors and issues regarding their effective use (RPI, 1992; Audin, 1993; EPRI, 1994).

Classroom occupancy sensors were located in a corner near the teachers desk to minimize false "offs" when only the teacher was in the classroom. All occupancy sensors were set to a 12 minute time delay, which has worked well in most situations. Shorter time delays will increase savings, however, false "offs" may also increase. Past installation experience has shown that unless the occupancy sensors are properly located, aimed and tested by experienced personnel, poor savings and occupant dissatisfaction will result. Figures 11 and 12 show time delay adjustment on one the ceiling-mounted occupancy sensors as well as use of run time loggers to verify control performances.

VII. Data Analysis

Accurate assessment of lighting savings must be performed when the occupancy patterns vary the least from the pre and post periods. Since the most regular occupancy patterns occur during school days, accurate assessment of lighting savings can only be performed during this time period. Although savings are not being evaluated for the entire year, school days account for approximately 93% of the total yearly lighting demand and therefore are a good indicator of yearly savings. Average daily total electrical consumption and average daily lighting consumption for the pre and post-retrofit monitoring period are shown in Figure 13 for *school* days. The pre-retrofit period extended from February 27, 1995 - June 9, 1995, comprising some 69 school days and 30 non-school days. The post retrofit period began on September 5, 1995 and ended on December 8, 1995, comprising 84 school days and 28 non-school days.

Location of Occupancy Sensors

North West Elementary School
Pasco County School District

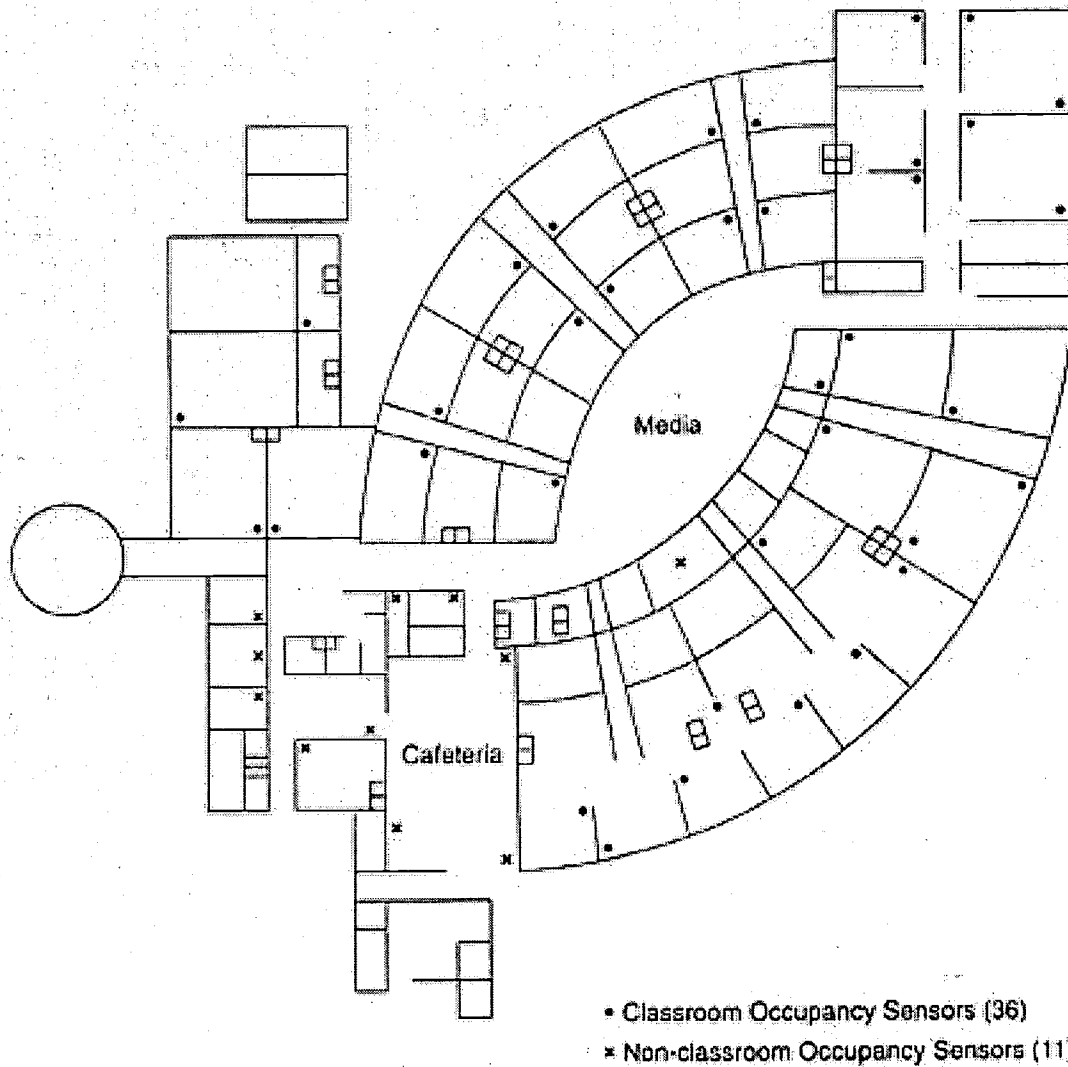


Figure 8. Floor plan of main building at Northwest Elementary School in Pasco County indicating location of occupancy sensors.

BEST COPY AVAILABLE



Figure 9. Interior layout of lighting system in a typical classroom at Northwest Elementary. The lighting fixtures consist of four T-8 fluorescent lamps with an electronic ballast in a white troffer covered by an acrylic prismatic diffuser.



Figure 10. FSEC engineer David Floyd installs run-time metering equipment inside a single classroom lighting fixture. Note the ceiling mounted occupancy sensor, located so as to scan the entire classroom for motion

BEST COPY AVAILABLE

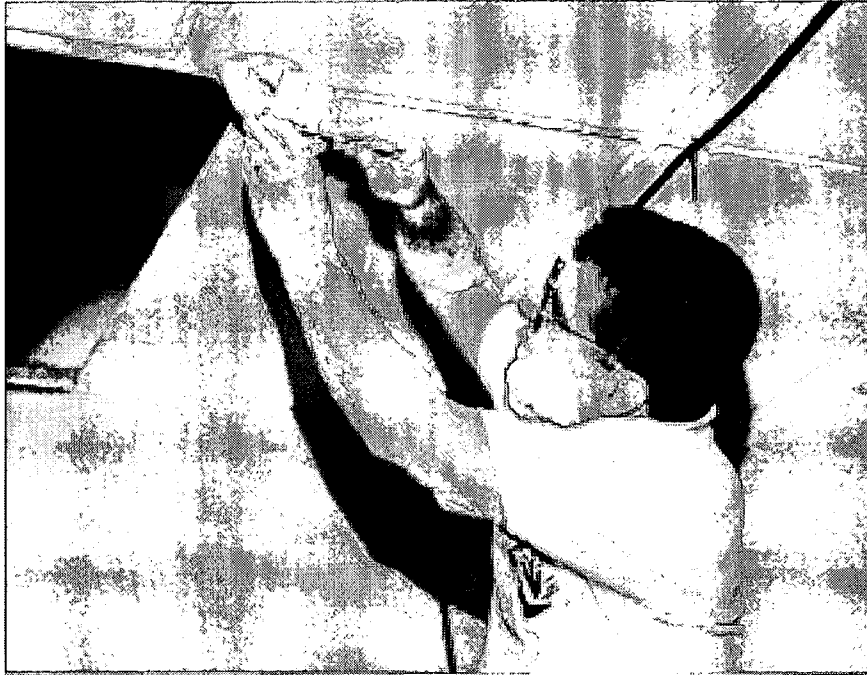



Figure 11. Pasco County School Board Energy Coordinator, Mike Woodall, assists with the time delay adjustment of one of the ceiling mounted occupancy sensors. The project found that proper set-up of the time delay and sensitivity of the controls was essential to acceptable performance.



Figure 12. David Floyd checks the function of a time of use lighting logger (small white box) which is installed inside the lighting fixture. The lighting loggers were used to verify the proper performance of the occupancy sensor controls during unoccupied periods.

Northwest Elementary Test Site (PCO)

Total Use on School Days

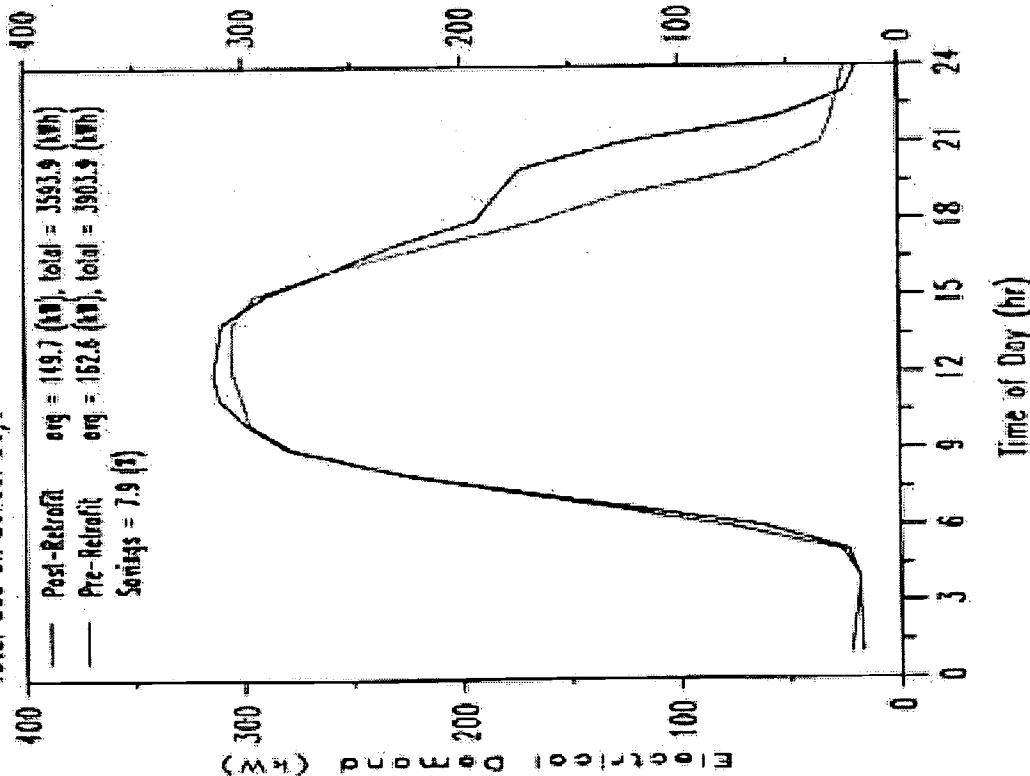

Northwest Elementary Test Site (PCO)

Lighting Use on School Days

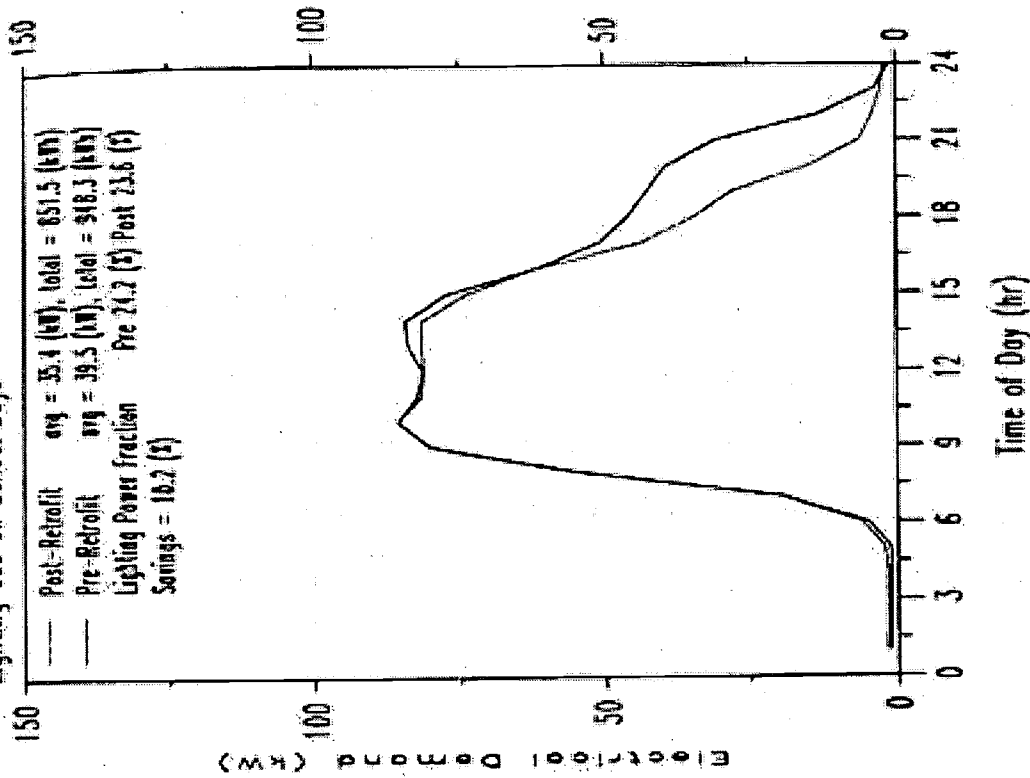


Figure 13. Average total (left) and lighting (right) electricity demand profiles measured at Northwest Elementary five months before and after occupancy sensor retrofit.

Of the total power demand during the pre-retrofit periods, 24.2% was used for interior lighting. This is consistent with simulation predictions for a school facility with a T8 lighting system (McIlvaine, et al, 1994). Lighting systems using older technology such as T12 lamps and magnetic ballasts (which comprise the lighting systems in the majority of Florida schools) would use a greater percentage of the total for lighting power and would benefit more from the use of occupancy sensors.

Upon first examination of the lighting use plot in Figure 13, it is evident that prior to the installation of the occupancy sensors there was little unintentional lighting during classroom hours. A small dip in the post retrofit plot can be seen between 9:30 AM and 1:45 PM, when lights are manually turned off during lunch. Also, when the school is vacated (when the night custodians leave) from approximately 10 PM until the next morning, lights were almost never left on. The diligent operation is due primarily to the effective energy management program in Pasco County. *Thus, a fundamental point to be made regarding this study is that the savings level from adding occupancy sensors is likely to be as low as might be seen in almost any educational facility.* Other schools with typically less efficient lamps and less responsible operation would experience considerably greater savings.

The post retrofit electrical demand lighting profile in Figure 13 shows the additional savings produced by the occupancy sensors. Savings are seen primarily after the school day ends, although there are some reductions evident between lunch and 4:30 PM. Approximately 124 kWh are being saved each school day by the retrofit. This results in a 10.2% savings (96.8 kWh/school day) in lighting, which is quite substantial for a school that already practices good energy management. Analysis of data on non school days is inconclusive since the occupancy patterns changed between the pre and post periods. However, previous research at FSEC suggests that if there are savings during non-school days, they are small or possibly negative.

However 93% of the total power used during the year is on school days, and therefore would not be influenced greatly by the non-school day results. Using the lighting load savings between the pre and post periods (96.8 kWh/school day) and assuming that there are 200 school days per year the total lighting savings for the year is 19,360 kWh.

Since lighting use also increases the load on the cooling system, a reduction in lighting use would also lower the cooling load, especially in central Florida where space cooling is the dominant end-use (approximately 90% of the year or 10.8 months). Total energy savings must also include the reduction in the cooling load.

Indirect, cooling load savings is calculated as follows (Runquist, et al., 1993):

$$\begin{aligned}\text{Cooling Energy Savings} &= L_{\text{kWh}} \times \text{Fraction to cooling} / \text{HVAC COP} \\ &= 19,360 \times 0.90 / 2.4 \\ &= 7,260 \text{ kWh/year}\end{aligned}$$

Where:

L_{kWh} = annual lighting energy consumption (kWh)
Fraction to Cooling = fraction of lighting heat to cooling loads
HVAC COP = cooling system seasonal coefficient of performance.

VIII. Economic Analysis

The economic analysis will consider the lighting savings as well as the additional savings from cooling load reduction. The resulting total yearly energy savings of 26,620 kWh includes lighting (19,360 kWh) and cooling (7,260 kWh).

Withlacoochee River Electric Cooperative provides the power for Northwest Elementary School. Their monthly utility rate is based on a fixed consumer charge (\$24.63), a demand charge (\$6.16/kW), and a energy charge (\$.04765/kWh). Examination of the lighting demand profile in Figure 13 shows no reduction in the average maximum demand between the pre and post periods. Most of the savings occur during the evening hours. Thus the only monetary savings will be due to a reduction in energy (kWh). It is important to note, however, that this is not always the case. When occupancy sensors are used to control a building with a varying occupancy schedule, such as a university, demand savings may be significant.

Using the energy charge of \$.04765/kWh the following savings were achieved:

Table 3
Estimated Annual Savings from Occupancy Sensors at Northwest Elementary School

	kWh Savings	\$ Saved
Lighting	19,360	\$923
Cooling	7,260	\$345
Total	26,620	\$1,267

Material and installation costs for this project were as follows:

Materials: \$4,067 (sensors, relay packs, wire)
Installation: \$2,000
Total: \$6,067

The ratio of the savings to cost results in a payback period of 4.8 years and a simple rate of return of 21%. This is superior to the after-tax revenues generated by almost any conventional investment and represents a good use of discretionary funds.

IX. Conclusions

Retrofit of occupancy sensors in a Florida school showed a measured reduction in lighting energy use of 10.2%. The economics were also attractive with a 4.8 year payback and a 21% simple rate of return. The resulting savings from this project are very promising considering that the schools energy was already being managed quite well and the lighting systems efficiency was already improved through ballast/lamp upgrades.

If the schools lighting system was typical (magnetic ballasts with T12 lamps), it would be approximately 40% less efficient. Lighting savings would increase to 27,104 kWh/year and cooling savings would increase to 10,164 kWh/year. Under these circumstances the total monetary savings would be \$1,776 with a payback period of 3.4 years. If lights are frequently left on after hours, the use of occupancy sensors becomes even more attractive. We estimate that unintentional lighting hours, and therefore saving, would be greater at most Florida educational facilities.

Occupancy sensors offer an accurate control method for lighting, if installed and set up properly. They eliminate manual lighting control methods (i.e. last one out turns the light off) and provide better savings than time based control. Schools can benefit from this technology if it is installed properly in appropriate areas. Appropriate areas can easily be determined through the use of lighting loggers, and other techniques such as random occupancy audits.

X. Follow Up

Our findings clearly showed an attractive economic performance of an occupancy sensor retrofit in a Florida school which was already practicing diligent energy management activities. However, to gauge typical savings that might be experienced in Florida schools, we suggest that the study be repeated in another more typical educational facility with less stringent energy management activities. This would help to better define average savings levels from this technology.

XI. Acknowledgements

The Florida Solar Energy Center would like to express its appreciation of the Florida Department of Education in supporting this research. The cooperation of the Pasco County School Board and the staff of the Northwest Elementary School is also gratefully acknowledged. Finally, the *WattStopper Corporation* provided a generous accommodation for the purchase of the equipment in return for an objective third party assessment.

XII. Contacts

For more information on this project or others please contact:

Suzanne Marshall
Florida Department of Education
Office of Educational Facilities
325 West Gaines, Street
Tallahassee, FL 32399-0400

OR

David B. Floyd
Florida Solar Energy Center
1679 Clearlake Road
Cocoa, FL 32922
Phone: (407)638-1429
FAX: (407)638-1439

XIII. References

- BDAC Energy Files. 1995, "Occupancy Sensor Study," Building Design Assistance Center, FSEC, Vol. 3, No. 1, Cocoa, FL.
- Watt Stopper, 1994. "Class Room Energy Savings with Dual Technology," Watt Stopper Corporation, Santa Clara, CA.
- Synergic Resources Corporation, 1992. Electricity Conservation and Energy Efficiency in Florida: Phase I Final Report. SRC Rpt. 7777-RC, Florida Energy Office, Tallahassee, FL.
- McIlvaine, J.E.R., Mallette, M.M., Parker, D.S., Lapujade, P., Floyd, D.B., Schrum, L., and Stedman, T.C., 1994. Energy Efficient Design for Florida Educational Facilities. Florida Department of Education, Tallahassee, and the Florida Solar Energy Center, Cape Canaveral.
- Rundquist, R.A., Johnson, K.F., Aumann, D.J., 1993. "Calculating Lighting and HVAC Interactions," ASHRAE Journal, November 1993, pp. 28 - 36
- Audin, L. 1993. "Occupancy Sensors: Promise and Pitfalls," E-Source Tech Update, Old Snowmass, CO.
- ASHRAE, 1989. ASHRAE Standard 90.1: Energy Efficient Design of New Buildings Except New Low Rise Residential Buildings, American Society of Heating, Refrigerating and Air Conditioning Engineers, Atlanta, GA.
- CADDET, 1995. "Saving Energy With Efficient Lighting in Commercial Buildings," Maxi Brochure 01, Centre for the Analysis and Dissemination of Demonstrated Energy Technologies, Sittard, The Netherlands.
- Energy User News, 1991. "Maturing Technology Brings Growing Acceptance of Sensors," Energy User News Technology Report, September, 1991.
- EPRI, 1993. TAG Technical Assessment Guide, Vol. 2: Electricity End Use, Pt. 2: Commercial Electricity Use, Electric Power Research Institute, Palo Alto, CA.
- EPRI, 1994. "Occupancy Sensors: Positive On/Off Lighting Control," EPRI BR-100323, Electric Power Research Institute, Palo Alto, CA.
- Novitas, 1993. "Cost-Benefit Calculations," product literature, Novitas Corp., Culver City, CA.
- Rensaelaer Polytechnic Institute, 1992. Specifier Reports: Occupancy Sensors, Vol. 1, No. 5, National Lighting Product Information Program, October, 1992.

Richman, E., Dittmer, A.L. and Keller, J.M., 1994. Field Analysis of Occupancy Sensor Operation: Parameters Affecting Lighting Energy Savings, PNL-10135, Pacific Northwest Laboratory, Richland, WA.

Appendix B

Overview of Occupancy Sensor Technology and Manufacturer Literature

I. Sensor Technology

Occupancy sensors, also called motion sensors, react to disturbance in a space. They are designed to turn lights or other equipment on when the space is occupied and off (after a specified time delay) when the space is vacated. The most common load controlled is lighting; however, more recently occupancy sensors can be designed to control heating ventilating and air conditioning (HVAC), and office equipment (monitors, printers, fans, etc.). The most common occupancy sensors in use today use ultrasonic or infrared sensing techniques to detect occupancy. Each technology has its advantages and disadvantages.

Ultrasonic (US) occupancy sensors emit inaudible sound waves that bounce off objects in the room. It then measures the time it takes for the sound wave to return. If there is any movement in the controlled area the sound waves will return at a faster or slower rate, resulting in a Doppler shift and occupancy detection. US sensors can detect motion around corners. This makes them useful for spaces with large obstructions, such as bath rooms. US sensors work best when movement is toward and away from the sensor. The magnitude of required motion increases with distance from the sensor.

Passive Infrared (PIR) sensors sense occupancy by "noticing" the difference between a human body and the background. They accomplish this by dividing the coverage area into zones. When a person passes from one zone to another, the sensor detects occupancy. The better sensors have more coverage zones. PIR sensors are a "line of site" sensor and must have an unobstructed view of the entire coverage area. PIR sensors work best when the movement is tangential to the sensor. The magnitude of motion required to trigger the sensor is directly proportional to the distance from the sensor.

One or both sensor types can be incorporated into a myriad of different designs. The most common being automatic wall switches and ceiling mounted sensors.



REPRODUCTION RELEASE

(Blanket)

I. DOCUMENT IDENTIFICATION (Class of Documents):

All Publications: See attached list of publications	
Series (Identify Series): Educational facilities documents	
Division/Department Publications (Specify): Florida Solar Energy Center	Publication Date: Various

II. REPRODUCTION RELEASE:

In order to disseminate as widely as possible timely and significant materials of interest to the educational community, documents announced in the monthly abstract journal of the ERIC system, *Resources in Education* (RIE), are usually made available to users in microfiche, reproduced paper copy, and electronic media, and sold through the ERIC Document Reproduction Service (EDRS). Credit is given to the source of each document, and, if reproduction release is granted, one of the following notices is affixed to each document.

If permission is granted to reproduce and disseminate the identified documents, please CHECK ONE of the following three options and sign at the bottom of the page.

The sample sticker shown below will be affixed to all Level 1 documents

The sample sticker shown below will be affixed to all Level 2A documents

The sample sticker shown below will be affixed to all Level 2B documents

PERMISSION TO REPRODUCE AND DISSEMINATE THIS MATERIAL HAS BEEN GRANTED BY

_____ Sample _____

TO THE EDUCATIONAL RESOURCES INFORMATION CENTER (ERIC)

1

PERMISSION TO REPRODUCE AND DISSEMINATE THIS MATERIAL IN MICROFICHE, AND IN ELECTRONIC MEDIA FOR ERIC COLLECTION SUBSCRIBERS ONLY, HAS BEEN GRANTED BY

_____ Sample _____

TO THE EDUCATIONAL RESOURCES INFORMATION CENTER (ERIC)

2A

PERMISSION TO REPRODUCE AND DISSEMINATE THIS MATERIAL IN MICROFICHE ONLY HAS BEEN GRANTED BY

_____ Sample _____

TO THE EDUCATIONAL RESOURCES INFORMATION CENTER (ERIC)

2B

Level 1

↑

Level 2A

↑

Level 2B

↑

Check here for Level 1 release, permitting reproduction and dissemination in microfiche or other ERIC archival media (e.g., electronic) and paper copy.

Check here for Level 2A release, permitting reproduction and dissemination in microfiche and in electronic media for ERIC archival collection subscribers only

Check here for Level 2B release, permitting reproduction and dissemination in microfiche only

Documents will be processed as indicated provided reproduction quality permits.
If permission to reproduce is granted, but no box is checked, documents will be processed at Level 1.

I hereby grant to the Educational Resources Information Center (ERIC) nonexclusive permission to reproduce and disseminate these documents as indicated above. Reproduction from the ERIC microfiche or electronic media by persons other than ERIC employees and its system contractors requires permission from the copyright holder. Exception is made for non-profit reproduction by libraries and other service agencies to satisfy information needs of educators in response to discrete inquiries.

Sign here, → please

Signature: 	Printed Name/Position/Title: Mark Yerkes Assistant Vice President for Research	
Organization/Address: University of Central Florida / Florida Solar Energy Center 1679 Blarlane Rd. Cocoa FL 32922-5703	Telephone: (407) 823-3778	FAX: (407) 823-3299
	E-Mail Address:	Date: 6-11-99

**U.S. Department of Education
ERIC Reproduction Release**

Callahan, M.P. and D. S. Parker (1999). "Energy Efficient Florida Educational Facilities: Phase V Progress Report Phase I and II". FSEC-CR-1063-99, Florida Solar Energy Center, Cocoa, Florida.

Davanagere, B., K. Rengarajan, D. Shirey and R. Raustad (1996). "Impacts of ASHRAE Standard 62-1989 on Florida Schools, Final Report." FSEC-CR-856-95, Florida Solar Energy Center, Cocoa, Florida.

Davanagere, B., D. Shirey, K. Rengarajan and F. Colacino. "Mitigating the Impacts of ASHRAE Standard 62-1989 on Florida Schools", ASHRAE Transactions, Vol. 103, Part 1.

✓ Floyd, D. B., D. S. Parker, J. E. R. McIlvaine, and J. R. Sherwin (1995). "Energy Efficiency Technology Demonstration Project for Florida Educational Facilities: Occupancy Sensors". FSEC-CR-867-95, Florida Solar Energy Center, Cocoa, Florida.

Floyd, D. B. and D. S. Parker (1994). "Field Commissioning of a Daylight-Dimming Lighting System". FSEC-PF-283-94, Florida Solar Energy Center, Cocoa, Florida.

Floyd, D. B., D. S. Parker, J. R. Sherwin (1996). "Measured Field Performance and Energy Savings of Occupancy Sensors: Three Case Studies". FSEC-PF-309-96, Florida Solar Energy Center, Cocoa, Florida.

McIlvaine, J. E. R., M. Mallette, D. Parker, P. Lapujade, D. Floyd., L. Schrum, and T. Stedman (1994). "Energy Efficiency Design for Florida Educational Facilities", prepared for the Florida Department of Education, Florida Solar Energy Center, Cocoa, Florida.


Parker, D. S., J. R. Sherwin, J. K. Sonne, S. F. Barkasze, Jr. (1996).

"Demonstration of Cooling Savings of Light Colored Roof Surfacing in Florida Commercial Buildings: Our Savior's School." FSEC-CR-904-96, Florida Solar Energy Center, Cocoa, Florida.

Sherwin, J. R. and D. S. Parker (1996). "FLASTAR: Florida Alliance for Saving Taxes and Energy Resources". FSEC-CR-916-96, Florida Solar Energy Center, Cocoa, Florida.

Shirey, D., R. Raustad and M. Brassard (1997). "Evaluation of an Enthalpy Recovery Ventilator Installed in a Portable Classroom", Final Report, FSEC-CR-972-97. Florida Solar Energy Center, Cocoa, Florida.

Shirey, D (1998). "Evaluation of an Enthalpy Recovery Ventilator Installed in a Portable Classroom", Proceedings of ASHRAE's IAQ & Energy 1998.



Mr. Mark Yerkes
Assistant Vice President for Research

6-11-99

Date