

DOCUMENT RESUME

ED 433 688

EF 005 605

AUTHOR Floyd, David B.; Parker, Danny S.
TITLE Field Commissioning of a Daylight-Dimming Lighting System.
INSTITUTION Florida Solar Energy Center, Cape Canaveral.
REPORT NO FSEC-PF-283-94
PUB DATE 1995-06-00
NOTE 10p.; Presented at the Right Light Three, Third European Conference on Energy-Efficient Lighting (Newcastle upon Tyne, England, June 18-21, 1995).
AVAILABLE FROM Florida Solar Energy Center, 1679 Clearlake Rd., Cocoa, FL 32922-5703.
PUB TYPE Reports - Research (143) -- Speeches/Meeting Papers (150)
EDRS PRICE MF01/PC01 Plus Postage.
DESCRIPTORS Classroom Environment; Comparative Analysis; *Dining Facilities; *Elementary Schools; Elementary Secondary Education; *Energy Management; *Lighting; Public Schools
IDENTIFIERS Florida; Retrofitting; Technology Implementation

ABSTRACT

A Florida elementary school cafeteria, retrofitted with a fluorescent lighting system that dims in response to available daylight, was evaluated through real time measurement of lighting and air conditioning power, work plane illumination, and interior/exterior site conditions. The new system produced a 27 percent reduction in lighting power due to dimming. Lower than expected dimming system performance was observed prior to effective commissioning. Difficulties encountered are discussed as are recommendations for performance improvements. (Contains seven references and four figures.) (GR)

* Reproductions supplied by EDRS are the best that can be made *
* from the original document. *

Field Commissioning of a Daylight-Dimming Lighting System

FSEC-PF-283-94

David B. Floyd
Danny S. Parker

Florida Solar Energy Center
300 State Road 401
Cape Canaveral, Florida 32920

EF 005 605

U.S. DEPARTMENT OF EDUCATION
Office of Educational Research and Improvement
EDUCATIONAL RESOURCES INFORMATION
CENTER (ERIC)

- This document has been reproduced as received from the person or organization originating it.
- Minor changes have been made to improve reproduction quality.

- Points of view or opinions stated in this document do not necessarily represent official OERI position or policy.

PERMISSION TO REPRODUCE AND
DISSEMINATE THIS MATERIAL HAS
BEEN GRANTED BY

Mark Yerkes

TO THE EDUCATIONAL RESOURCES
INFORMATION CENTER (ERIC)

1

Presented at the Right Light Three, 3rd European Conference on Energy-Efficient Lighting, June 18-21, 1995 in Newcastle upon Tyne, England. Views and opinions expressed here represent those of the authors and not necessarily those of the Florida Solar Energy Center.

Abstract

An Elementary School cafeteria in Florida was commissioned with a fluorescent lighting system that dims in response to available daylight. The lighting system's performance and commissioning aspects were evaluated through real time measurement of lighting and air conditioning power, work plane illumination, and interior/exterior site conditions. The new system produced a 27% reduction in lighting power due to dimming. Lower than expected dimming system performance was observed prior to effective commissioning. Difficulties encountered are discussed as well as recommendations for performance improvements.

Introduction

Lighting energy usage in commercial office buildings accounts for a substantial portion of the total energy use. A recent study conducted in the state of Florida found that 33% of all commercial electricity use was from lighting loads (Parker et al. 1993). While there are many strategies to reduce lighting loads, automatic dimming electric lighting systems appear attractive where daylight is available (Rubinstein 1991). A recent *in situ* study of an automatic dimming system in a large office building measured up to 60% lower electricity use during the day, relative to a non-dimming system (Reed et al. 1994). Other investigations have also demonstrated the capabilities of these systems in reducing lighting loads, however few of these field studies have explored the commissioning aspects of automatic dimming lighting systems (Schrum and Parker 1995; Rubinstein et al. 1989; Verderber and Rubinstein 1994). The intent of this paper is to explore the performance and commissioning aspects of a daylight dimming lighting system in a typical windowed building and show how these systems might be optimized.

Building Characteristics

A 263 m² (13.5 m x 19.5 m) school cafeteria, located in central Florida (latitude 28°, longitude 81°), was selected for the field test of the daylight-dimming lighting system. The building's east and west facades are more than 70% glazing which provides abundant natural daylight to the buildings interior which doubles as a cafeteria and auditorium. The east facade is partially shaded from a covered walkway. Vertical blinds had been previously installed, on all windows, in an attempt to control unwanted heat and glare. Prior to retrofit, the building was lighted by 25 60 cm x 120 cm, recessed luminaires, each with two magnetic ballasts and four 40 W cool white, T12 lamps. Before monitoring began all the luminaires were thoroughly cleaned and new lamps (seasoned 100 hours) were installed to eliminate the effects of lamp lumen depreciation and luminaire dirt depreciation. Four ductless 10.5 kW/thermal heat pumps, located on the west wall, provide the necessary heating ventilating and air-conditioning (HVAC) requirements for the predominately hot, humid climate. The building and lighting system performance were monitored in the base condition for 3 months.

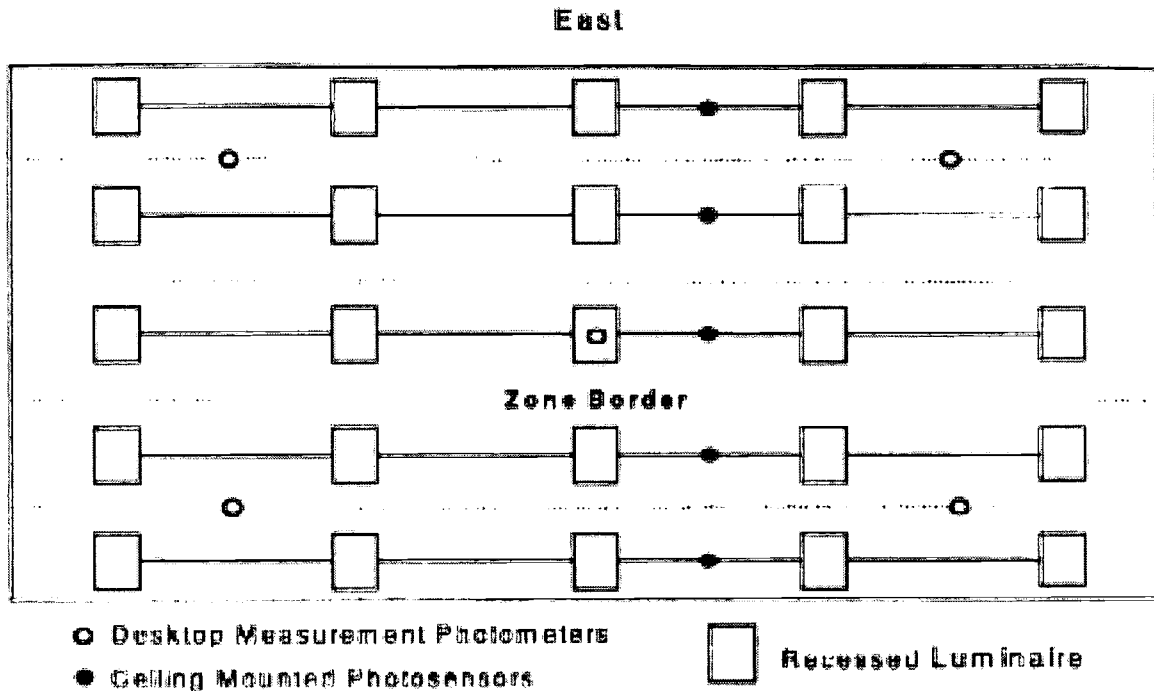


Figure 1. Schematic showing the five control zones, ceiling mounted photosensors, and measurement photometers.

The new controllable lighting system, installed in late June, near the summer solstice, replaced the inefficient magnetic ballasts and poor color rendering 40W T12 cool white lamps with a single electronic dimming ballast and two high color rendering (85CRI) 32W T8 lamps in each luminaire. The outer lamp sockets were used to mount the two new lamps to avoid the added labor of recentering the lamps. The building was divided into five linear north-south zones, with each zone of five luminaires controlled by a single ceiling mounted photosensor (Fig. 1). The photosensor regulates the light level (to a minimum of 20%) for the ballasts in each zone based on the available light measured in its conical field of view. These changes brought the lighting levels closer to the recommended Illumination Engineering Society (IES) level for cafeterias (300 Lux), increased the lighting system efficacy and allowed for more effective utilization of daylight.

To measure the effectiveness of the lighting retrofit, the building was monitored for lighting and air conditioning energy consumption, desktop light levels, meteorological parameters including horizontal insolation, interior conditions and luminaire temperatures. Five photometers mounted at desktop height record illuminance.

Instrumentation

Instrumentation used to monitor power, illumination and the interior/exterior site conditions

consisted of an expanded multi-channel datalogger (12 bit precision) and various monitoring devices. All sensors and power monitoring equipment was calibrated to a known accurate source before installation. The datalogger scans all 30 channels (except power) every ten seconds with integrated averages outputted to final storage every fifteen minutes. Power measurements are polled every ten seconds and totaled on fifteen minute intervals. The datalogger is interrogated nightly by a mainframe computer which archives the data and produces daily plots showing the 24 hour site conditions and lighting system performance. A sample plot is presented in Appendix A

The datalogger was used to poll the following types of sensors:

Power	Watt hour transducers recorded true root mean square (rms) power regardless of wave form distortion ($\pm 1\%$ accuracy of reading)
Illuminance	Silicon photodiode were used to record work surface illuminance ($\pm 5\%$ CIE curve match and 80° cosine correction). A precision 604 ohm resistor was used to convert the output to millivolts.
Solar Irradiance	Silicon photodiode pyranometer (80° cosine correction).

Results

Comparison of pre-retrofit data with post-retrofit data was performed to measure lighting energy savings and variations in desktop illumination levels. Overall lighting energy savings are further analyzed to determine actual energy savings solely due to the dimming capabilities of the system.

Actual measured performance

Before analysis of the lighting energy savings can be presented, it is important to understand the building's lighting usage pattern. Lighting is used only from Monday to Friday beginning at approximately 7AM and continuing through approximately 6PM. During the afternoon one or more of the three lighting circuits is usually switched off for a short period (30 to 60 minutes). While this off time is somewhat regular, it is, nevertheless, an uncontrolled variable that must be accounted for in the data analysis. Data used in all the analyses excludes weekend and holiday periods when the lighting was also off.

Initial examination of the average measured daily lighting power usage (kWh) before and after the new lighting system was installed shows a 66% decrease (Fig. 2). This value represents the actual lighting energy saved by the building (excluding heating and cooling interactions) and is influenced by weather, lighting "off" periods, and window blind control. When the influence of lighting "off" periods is removed, the total savings increase slightly to 69%.

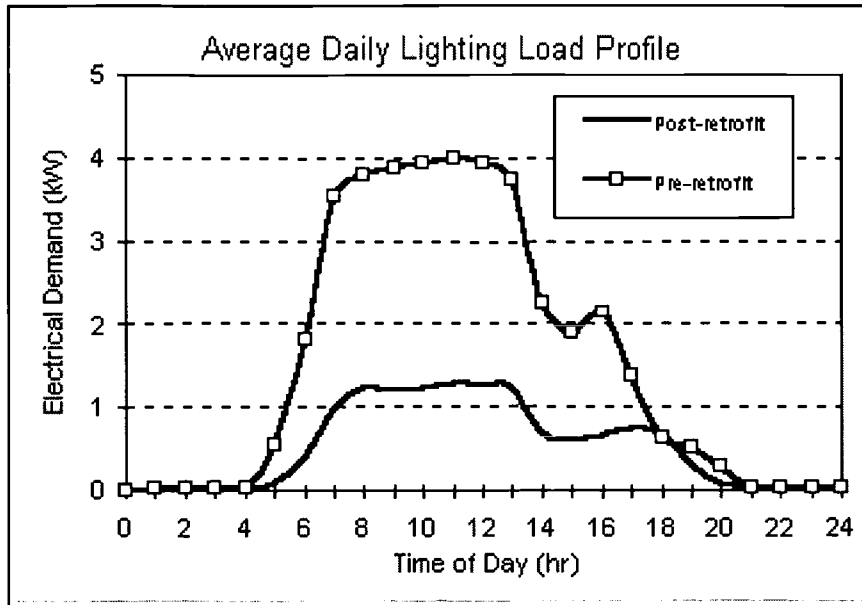


Figure 2. Average daily lighting load profile showing a 66% decrease.

Calculated annual energy savings

Before the dimming response of the system is analyzed, one must account for uncontrolled variables, primarily occupant control of the blinds and weather. In order to account for changes in day length, solar angle, and clouds, average solar irradiance for the year was calculated from pyranometer data at the site.

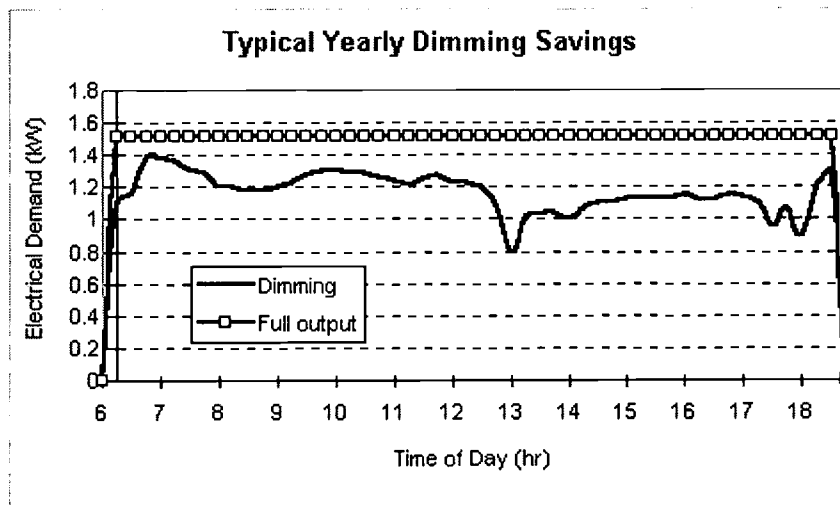


Figure 3. Average system dimming performance for a representative yearly period.

This was calculated to be an hourly average of 380 W/m². Average solar irradiance for the months of August and September combined was 385 W/m², within 2% of the yearly average. This time period was therefore used to estimate yearly dimming response for the lighting system. The graph in Figure 3 shows the average response during this time period and the power that would have been consumed without the dimming

capabilities (full power). The system dims an average of 27% over the period for a 402W average reduction for the period. Under ideal conditions (blinds open, clear day), the data show

that 36% dimming (58W reduction) from full output could be achieved.

The overall lighting power savings (nearly 76%) is a result of converting to a more efficient electronic ballast/lamps system, adding ballast dimming capabilities, and tuning light levels through delamping. The old system of magnetic ballasts and 40W T12 lamps consumed a maximum of 4.65 kW (186 watts/luminaire). The new system at full output was measured to consume a maximum of 1.5 kW (60 watts/luminaire). This equates to an impressive 67% reduction in full output lighting load and represents the savings attributed to the more efficient ballast/lamps and light level tuning only. The average additional savings from daylight dimming capabilities amount to 9% (402W), which equates to a total reduction of 76%. The dimming system on average dimmed 27% from full output. The lower than expected dimming performance is thought to be due to a number of factors including occupant control of the blinds, a less than optimal building design for daylighting and poor control photometer response.

Desktop Illumination

Energy savings are meaningless if lighting quality is compromised to such a degree that occupant comfort and productivity is affected. While all aspects of good lighting design cannot easily be measured, monitoring desktop illumination can provide information on the relative performance of a dimming system. As shown in Figure 4, average light levels in the cafeteria after commissioning fluctuated less and were still above the IES standard of 300 lux (IES 1992). Average post-retrofit light levels averaged 428 lux, only a 30% decrease from the average pre-retrofit level of 610 lux.

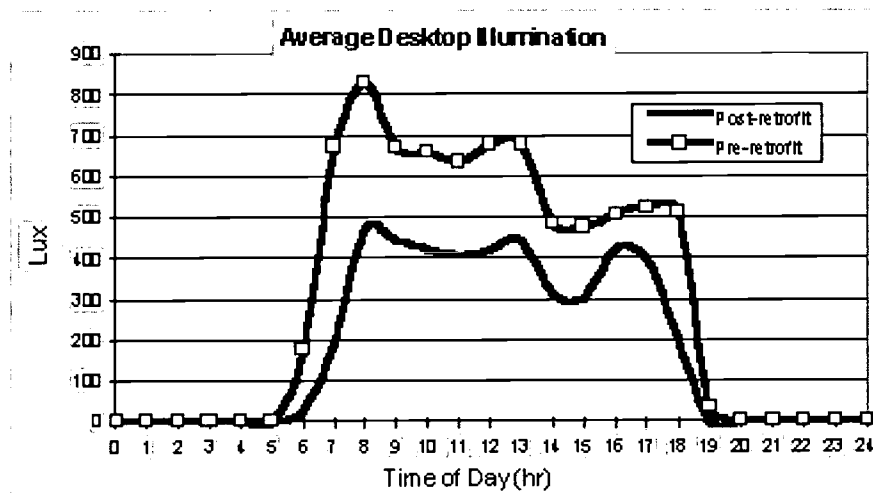


Figure 4.

Commissioning Difficulties

The dimming capacity of the system produced approximately a 27% reduction in the new systems lighting use. While the significant energy savings were anticipated from the new

system, the difficulties associated with installing and calibrating the control photosensors were not. When early data showed minimal dimming, an attempt was made to recalibrate the photosensors. However, proper dimming response was not achieved until the manufactured supplied shields were installed. It is believed that the shields prevented saturation of the sensor from daylight and reflections originating from the other side of the room. This allowed the sensor to better respond to light originating near the controlled zone. Post recalibration data showed an improvement to the dimming response.

Photosensor calibration difficulties such as the ones experienced during the case study are by no means unique. Our investigation, as well as a parallel study performing side by side testing of different photosensor designs, disclosed a number of problems. First, all manufacturer supplied instructions on proper adjustment of the photosensor-ballast response were found to be woefully inadequate. Proper adjustment of the daylighting system response required knowledge of the photosensor sensitivity range (for example, turning the set potentiometer too high can result in poor dimming response). We also found it difficult to adjust the photosensors to the desired illuminance level with any accuracy (± 50 lux) and the illuminance levels were often less during the day than at night (for example, an illuminance of 500 lux set at night would measure 400 lux during the day). We often resorted to a trial and error approach to obtain good dimming response. Lastly, the photosensor mounting location and shield (if supplied) use varied amongst the manufacturers. Most directions suggested a location of two-thirds the distance into the room from the window, however this was not applicable for our case study since we used linear control zones. Perhaps most importantly, none of the instructions suggested verification of realized room illuminance levels using hand held meters. We found this practice paramount to obtaining reasonable results.

Another factor affecting system performance is the control of the blinds since they are frequently drawn to reduce glare and localized overheating. Closing just one blind near the photosensor can drastically alter system dimming response. In our case study we could achieve as much as 36% dimming savings when the blinds were left open, but overall savings attributable to dimming diminished to 27% when control of the blinds was left to the occupants (Fig. 3). While such control is necessary, less obstruction of visible light is desirable so that the daylighting system will function as designed.

Conclusions

The retrofit resulted in a significant 76% overall reduction in interior lighting energy use from the original system, with the dimming capacity of the system responsible for approximately 11% (402W) of the total savings. Although this may appear low, it should be kept in mind that the dimming system produced a 27% reduction in lighting energy use for the new lamp/ballast configuration. Our study finds that a daylight dimming lighting system has the potential to save substantial energy, however if all factors influencing system operation are not addressed, then visual comfort and savings may be compromised. Proper commissioning of such systems is therefore seen as vital to realizing full system efficiency potential.

The Next Step

New building designs incorporating spectrally-selective glazings, light gathering devices, and controllable fluorescent ballast technology can offer significant reductions in energy use. However, older buildings with poor orientation and glazing present more challenges to successfully realize daylighting savings. Since the glare and solar heat gain need to be controlled without obstructing the visible light, we plan to apply a spectrally selective window film to exposed east and west windows of the cafeteria during July 1995. Spectrally selective films reject the near infrared solar radiation (heat) while admitting visible light. This is expected to significantly lower air conditioning consumption while also affecting the performance of the dimming system. Although adding the window film to the clear window glazings should theoretically reduce available daylight and dimming system performance (the film we plan to use has a visible transmittance of ~70%), the way in which the lower shading coefficient (0.50) may effect user operation of the east and west window blinds is potentially a large factor influencing the overall results. Since there will be less heat and glare, will the blinds remain open more often resulting in improved dimming savings? Our future research should provide some answers.

References

- Lighting Handbook - Reference & Application volume, 8th Addition*, New York: Illumination Engineering Society of North America SRC. 1992. Energy Conservation and Energy Efficiency in Florida: Phase I Final Report, SRC Report No. 7777-R3, Synergic Resources Corp. , Bala Cynwd, PA, USA.
- Parker, D.S., Stedman, T.C. and Sonne, J.K.. 1993. "Side-by-Side Testing of Commercial Lighting Systems", Florida Solar Energy Center FSEC-PF-265-93, Cocoa, Fl, USA
- Reed, J., Pinkowski, C., Caldwell, B., Mapp, J., White, S. and Hall, N., 1994. "Energy Savings from an Active Daylighting Retrofit and Impact on Building Practices", Proceedings of the 1994 Summer Study on Energy Efficiency in Buildings, Vol. 3., p. 217, American Council for an Energy Efficient Economy, Washington D.C.
- Rubinstein F., Ward G., Verderber R. 1989. "Improving the Performance of Photo-Electrically Controlled Lighting Systems", *Journal of the Illuminating Engineering Society of North America* 18, no. 1 pp. 70-94 USA.
- Rubinstein, F. 19 1. "Automatic Lighting Controls Demonstration: Long Term Results". Lawrence Berkeley Laboratory LBL-28793 Rev. UC-350, Berkeley, CA, USA. IES. 1993..
- Schrum, L. and Parker, D.S., March 1995. "Daylight Dimming and Energy Savings: The Effects of Window Orientation and Blinds", Florida Solar Energy Center FSEC-CR-792-95, Cocoa, Fl USA
- Verderber R. and F. M. Rubinstein. 1984. "Mutual Impacts of Lighting Controls and Daylighting Applications". *Energy and Buildings*, 6, pp. 133-140



REPRODUCTION RELEASE

(Blanket)

I. DOCUMENT IDENTIFICATION (Class of Documents):

All Publications: See attached list of publications	
Series (Identify Series): Educational facilities documents	
Division/Department Publications (Specify): Florida Solar Energy Center	Publication Date: various

II. REPRODUCTION RELEASE:

In order to disseminate as widely as possible timely and significant materials of interest to the educational community, documents announced in the monthly abstract journal of the ERIC system, *Resources in Education* (RIE), are usually made available to users in microfiche, reproduced paper copy, and electronic media, and sold through the ERIC Document Reproduction Service (EDRS). Credit is given to the source of each document, and, if reproduction release is granted, one of the following notices is affixed to each document.

If permission is granted to reproduce and disseminate the identified documents, please CHECK ONE of the following three options and sign at the bottom of the page.

The sample sticker shown below will be affixed to all Level 1 documents

The sample sticker shown below will be affixed to all Level 2A documents

The sample sticker shown below will be affixed to all Level 2B documents

PERMISSION TO REPRODUCE AND DISSEMINATE THIS MATERIAL HAS BEEN GRANTED BY

_____ Sample _____

TO THE EDUCATIONAL RESOURCES INFORMATION CENTER (ERIC)

1

PERMISSION TO REPRODUCE AND DISSEMINATE THIS MATERIAL IN MICROFICHE, AND IN ELECTRONIC MEDIA FOR ERIC COLLECTION SUBSCRIBERS ONLY, HAS BEEN GRANTED BY

_____ Sample _____

TO THE EDUCATIONAL RESOURCES INFORMATION CENTER (ERIC)

2A

PERMISSION TO REPRODUCE AND DISSEMINATE THIS MATERIAL IN MICROFICHE ONLY HAS BEEN GRANTED BY

_____ Sample _____

TO THE EDUCATIONAL RESOURCES INFORMATION CENTER (ERIC)

2B

Level 1

↑

Level 2A

↑

Level 2B

↑

Check here for Level 1 release, permitting reproduction and dissemination in microfiche or other ERIC archival media (e.g., electronic) and paper copy.

Check here for Level 2A release, permitting reproduction and dissemination in microfiche and in electronic media for ERIC archival collection subscribers only

Check here for Level 2B release, permitting reproduction and dissemination in microfiche only

Documents will be processed as indicated provided reproduction quality permits.
If permission to reproduce is granted, but no box is checked, documents will be processed at Level 1.

I hereby grant to the Educational Resources Information Center (ERIC) nonexclusive permission to reproduce and disseminate these documents as indicated above. Reproduction from the ERIC microfiche or electronic media by persons other than ERIC employees and its system contractors requires permission from the copyright holder. Exception is made for non-profit reproduction by libraries and other service agencies to satisfy information needs of educators in response to discrete inquiries.

Sign here, → please

Signature: 	Printed Name/Position/Title: Mark Yerkes Assistant Vice President for Research	
Organization/Address: University of Central Florida / Florida Solar Energy Center 1679 Clearlake Rd. Cocoa FL 32922-5703	Telephone: (407) 823-3778	FAX: (407) 823-3299
	E-Mail Address:	Date: 6-11-99



**U.S. Department of Education
ERIC Reproduction Release**

Callahan, M.P. and D. S. Parker (1999). "Energy Efficient Florida Educational Facilities: Phase V Progress Report Phase I and II". FSEC-CR-1063-99, Florida Solar Energy Center, Cocoa, Florida.

Davanagere, B., K. Rengarajan, D. Shirey and R. Raustad (1996). "Impacts of ASHRAE Standard 62-1989 on Florida Schools, Final Report." FSEC-CR-856-95, Florida Solar Energy Center, Cocoa, Florida.

Davanagere, B., D. Shirey, K. Rengarajan and F. Colacino. "Mitigating the Impacts of ASHRAE Standard 62-1989 on Florida Schools", ASHRAE Transactions, Vol. 103, Part 1.

Floyd, D. B., D. S. Parker, J. E. R. McIlvaine, and J. R. Sherwin (1995). "Energy Efficiency Technology Demonstration Project for Florida Educational Facilities: Occupancy Sensors". FSEC-CR-867-95, Florida Solar Energy Center, Cocoa, Florida.

✓ Floyd, D. B. and D. S. Parker (1994). "Field Commissioning of a Daylight-Dimming Lighting System". FSEC-PF-283-94, Florida Solar Energy Center, Cocoa, Florida.

Floyd, D. B., D. S. Parker, J. R. Sherwin (1996). "Measured Field Performance and Energy Savings of Occupancy Sensors: Three Case Studies". FSEC-PF-309-96, Florida Solar Energy Center, Cocoa, Florida.

McIlvaine, J. E. R., M. Mallette, D. Parker, P. Lapujade, D. Floyd., L. Schrum, and T. Stedman (1994). "Energy Efficiency Design for Florida Educational Facilities", prepared for the Florida Department of Education, Florida Solar Energy Center, Cocoa, Florida.


Parker, D. S., J. R. Sherwin, J. K. Sonne, S. F. Barkasze, Jr. (1996).

"Demonstration of Cooling Savings of Light Colored Roof Surfacing in Florida Commercial Buildings: Our Savior's School." FSEC-CR-904-96, Florida Solar Energy Center, Cocoa, Florida.

Sherwin, J. R. and D. S. Parker (1996). "FLASTAR: Florida Alliance for Saving Taxes and Energy Resources". FSEC-CR-916-96, Florida Solar Energy Center, Cocoa, Florida.

Shirey, D., R. Raustad and M. Brassard (1997). "Evaluation of an Enthalpy Recovery Ventilator Installed in a Portable Classroom", Final Report, FSEC-CR-972-97. Florida Solar Energy Center, Cocoa, Florida.

Shirey, D (1998). "Evaluation of an Enthalpy Recovery Ventilator Installed in a Portable Classroom", Proceedings of ASHRAE's IAQ & Energy 1998.



Mr. Mark Yerkes
Assistant Vice President for Research

6-11-99
Date