

DOCUMENT RESUME

ED 441 332

EF 005 725

AUTHOR Zimmerman, David
TITLE Shivers Junior/Senior High School: Aberdeen School District
in Mississippi. Case Study in Sustainable Design.
INSTITUTION Mississippi State Univ., Mississippi State. Educational
Design Inst.
PUB DATE 2000-00-00
NOTE 49p.
AVAILABLE FROM For full text: <http://www.edi.msstate.edu>.
PUB TYPE Reports - Descriptive (141)
EDRS PRICE MF01/PC02 Plus Postage.
DESCRIPTORS *Climate Control; *Educational Facilities Design;
*Educational Facilities Improvement; *Energy Management;
High Schools; Junior High Schools; *Lighting; Public Schools
IDENTIFIERS Mississippi


ABSTRACT

Design information, floor plan, photos, and energy use data are presented of a combined 45,000 square foot junior/senior high school in Mississippi's Aberdeen School District, built in 1956, and retrofitted over time to improve its usability. Exterior and interior photos are presented showing classrooms, the cafeteria, and gymnasium. Data are presented on the school's current energy use and every area where improvements are required. Lighting retrofit information and cost/savings data on a geothermal heat pump retrofit conclude the document. (GR)

Available at:
<http://www.edi.msstate.edu>

David Zimmerman, AIA

Case Study in Sustainable Design

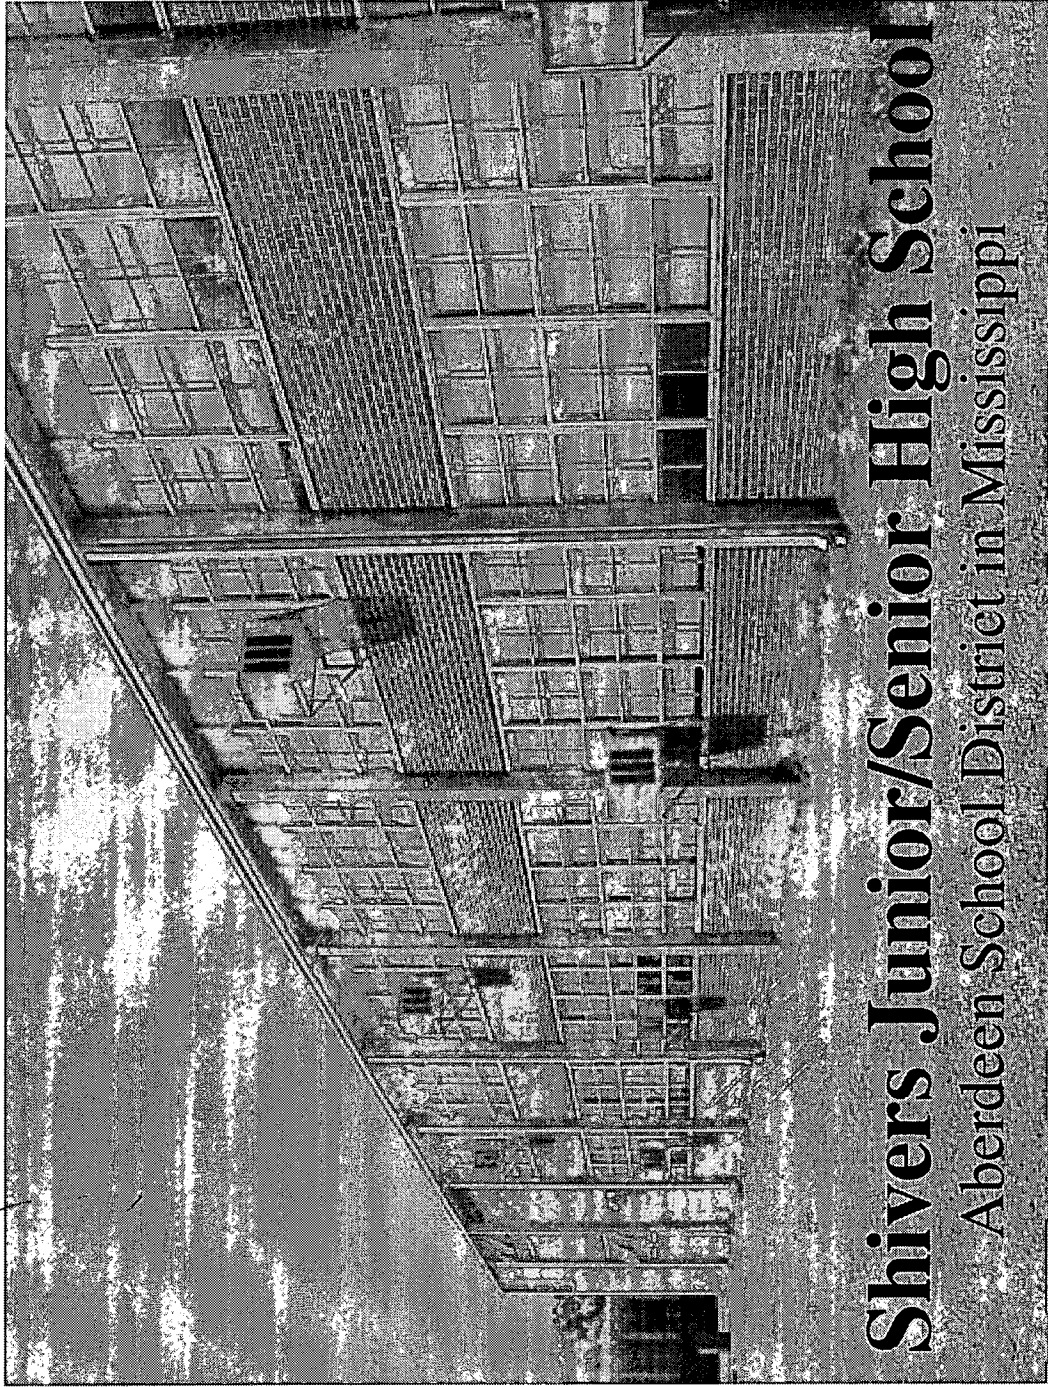

Shivers Junior/Senior High School
Aberdeen School District in Mississippi

U.S. DEPARTMENT OF EDUCATION
Office of Educational Research and Improvement
EDUCATIONAL RESOURCES INFORMATION
CENTER (ERIC)
This document has been reproduced as
received from the person or organization
originating it.
 Minor changes have been made to
improve reproduction quality.
 Points of view or opinions stated in this
document do not necessarily represent
official OERI position or policy.

PERMISSION TO REPRODUCE AND
DISSEMINATE THIS MATERIAL HAS
BEEN GRANTED BY

Jeffery Lackney

TO THE EDUCATIONAL RESOURCES
INFORMATION CENTER (ERIC)


1

Shivers Junior/Senior High School





Basic Description:

- Combined Junior/Senior High School in the Aberdeen School District in Mississippi
- Built in 1956, 45,000 sf brick & block construction, 667 students
- Single glazed windows, little or no insulation
- Originally hot water heat heating & natural ventilation cooling.
- Retrofitted over time with window and package AC units
- 1950's fluorescent light fixtures with T-12 lamps and magnetic ballasts

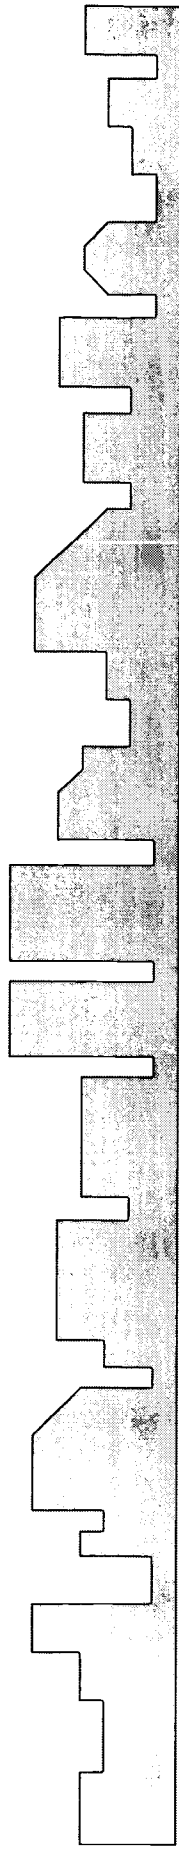


Shivers Junior/Senior High School

Floor Plan:

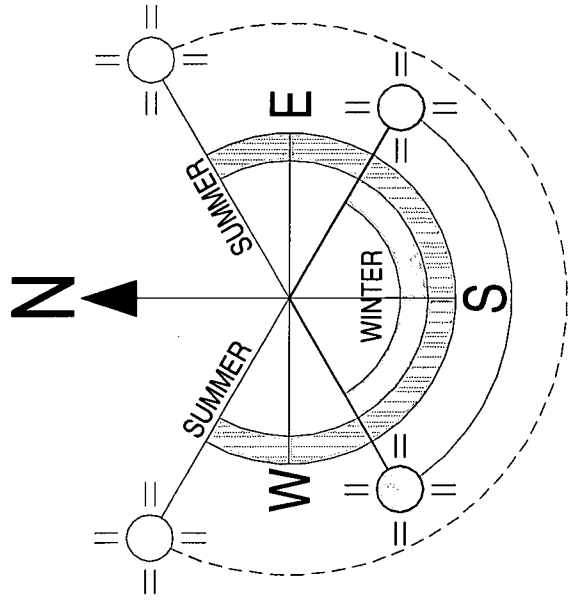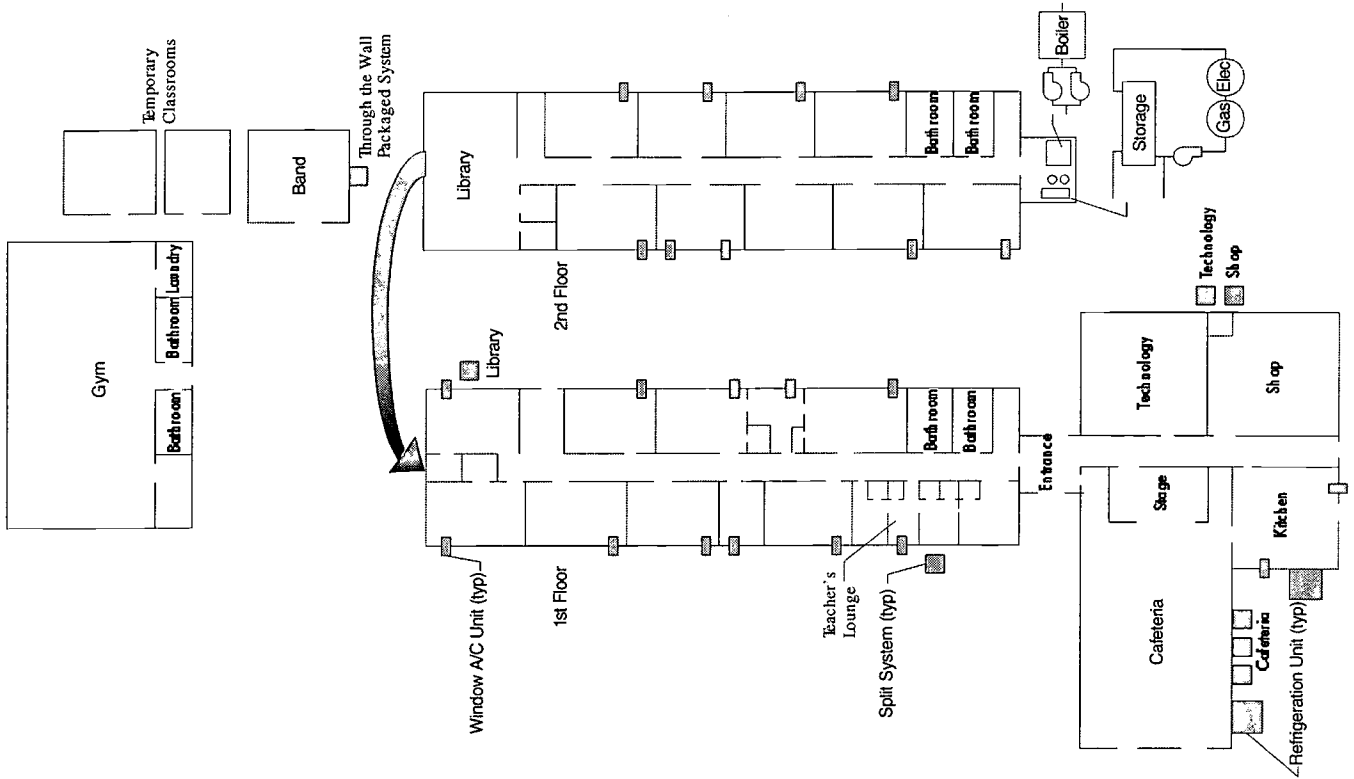


Shivers Junior/Senior High School


Exterior Photos – Classroom Wing

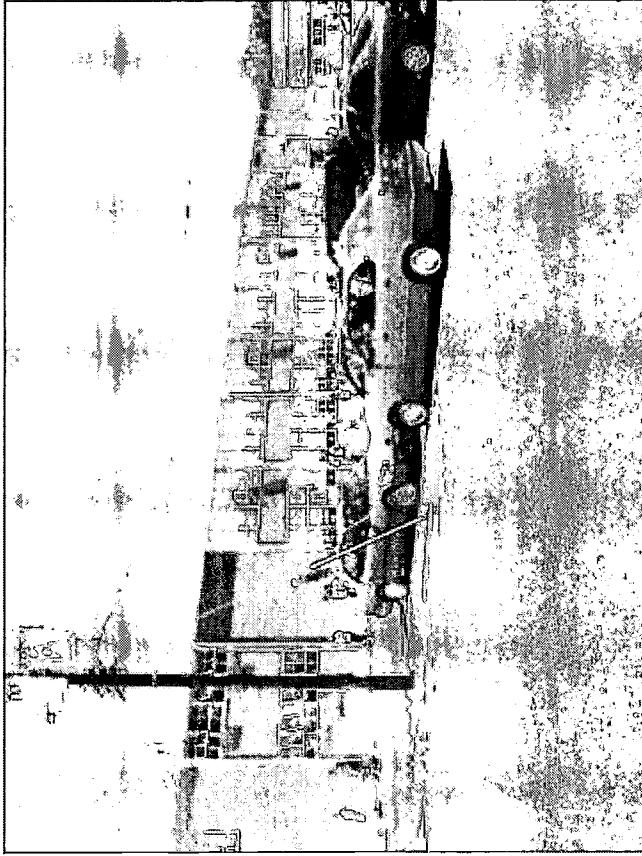

East Elevation

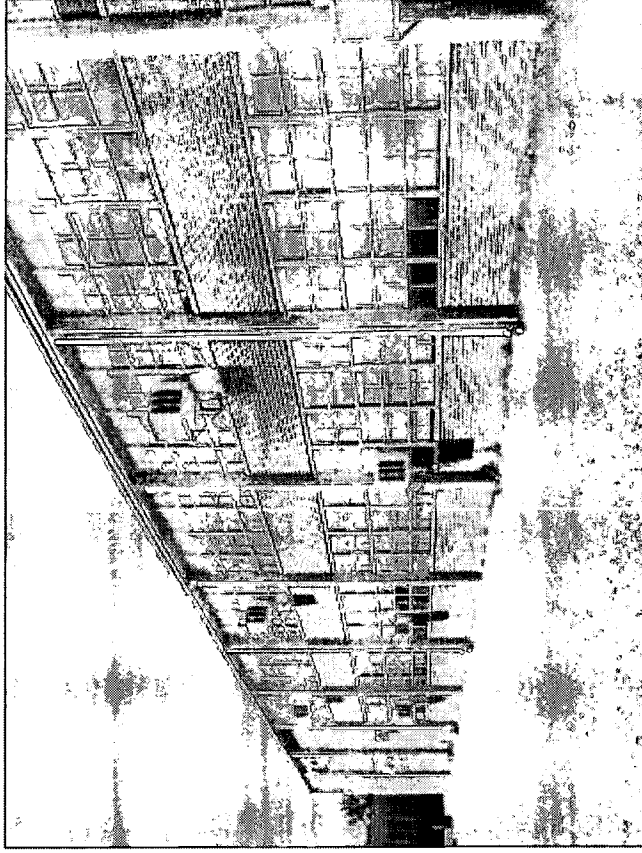


East Elevation

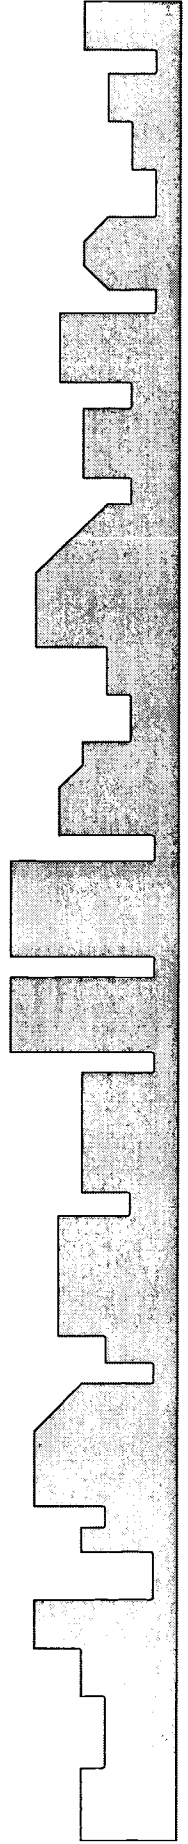



Shivers Junior/Senior High School

Interior Photos – Classroom Wing

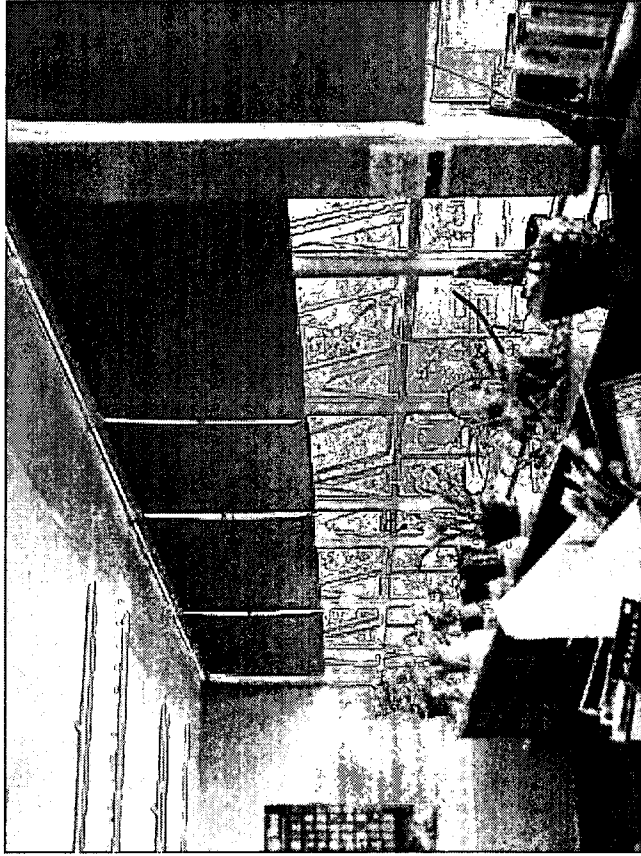


Typical Classroom

Hallway->

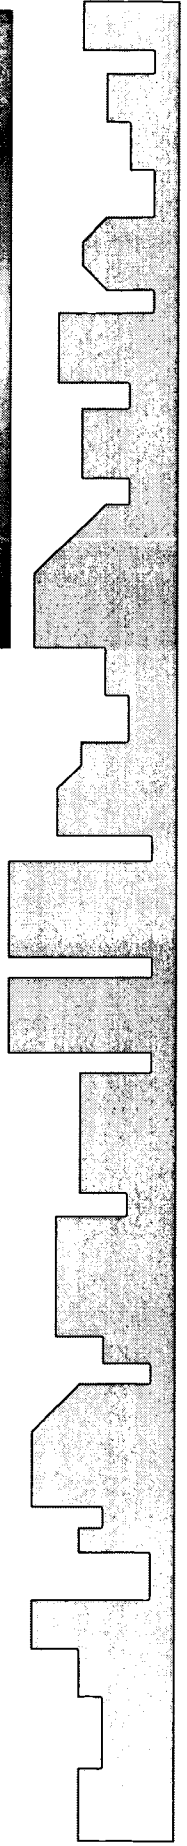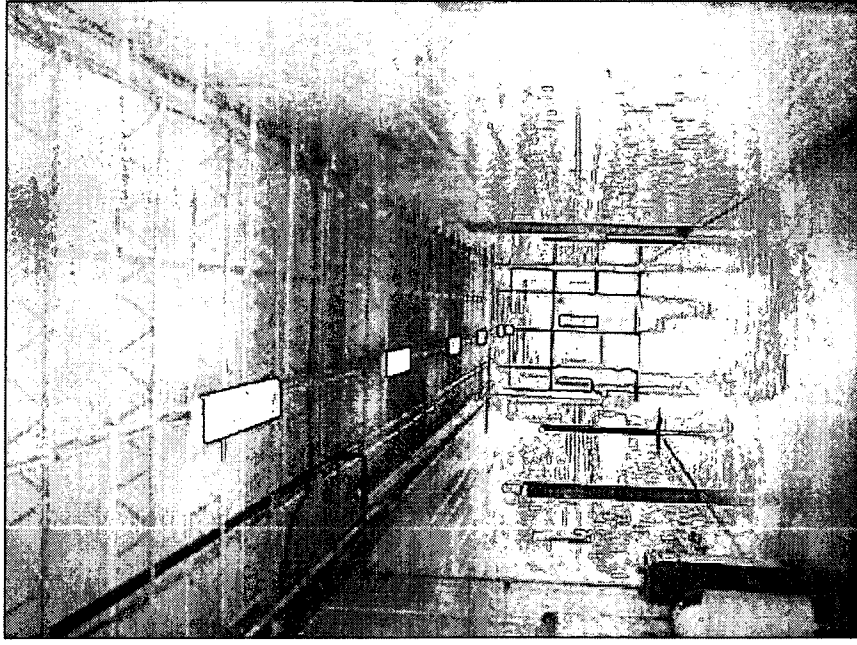


Shivers Junior/Senior High School


Exterior Photos – Cafeteria & Kitchen

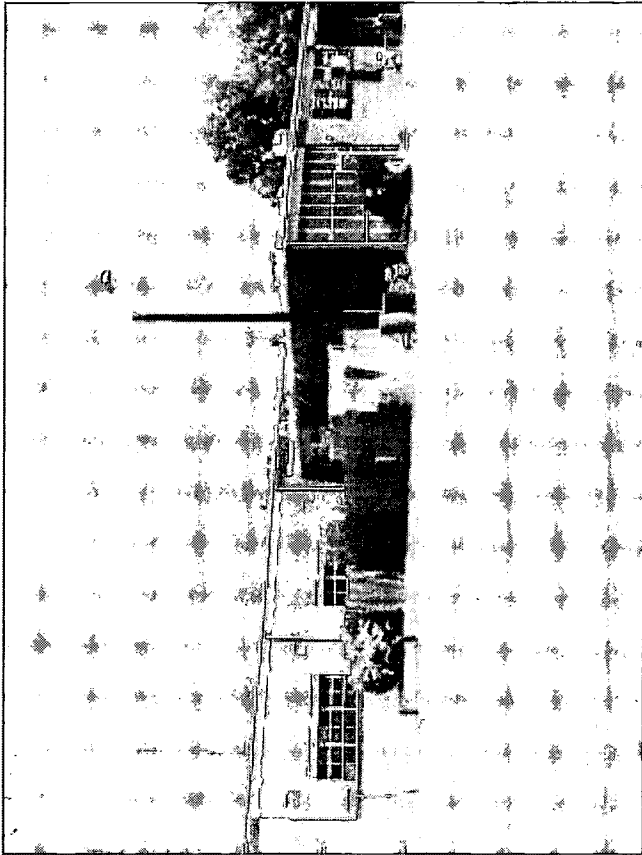

South Elevation



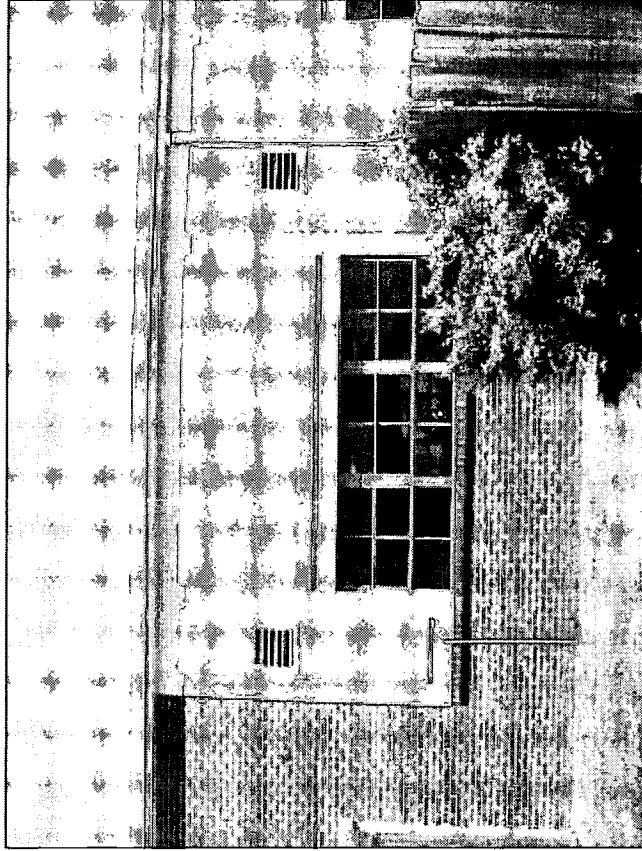


Closed windows & HVAC retrofit

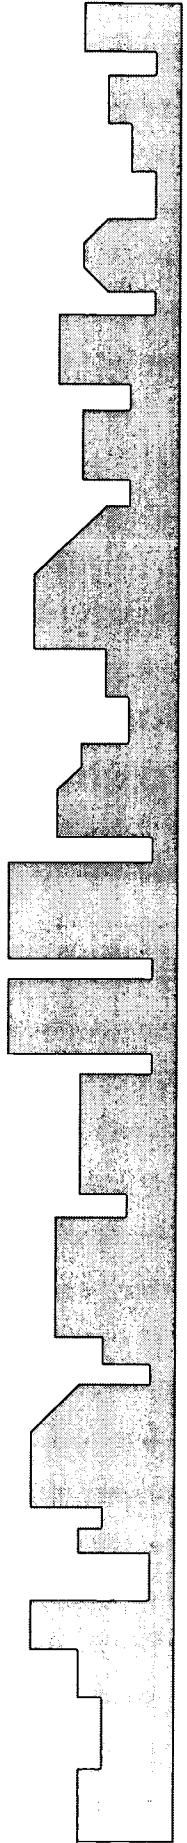


Shivers Junior/Senior High School

Interior Photos – Cafeteria & Kitchen

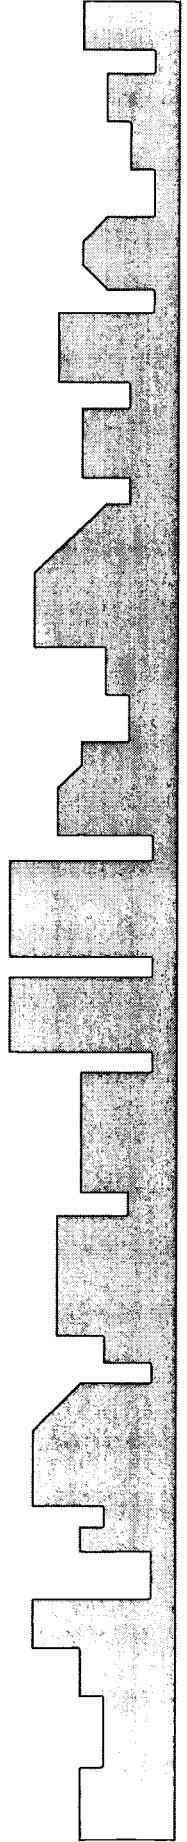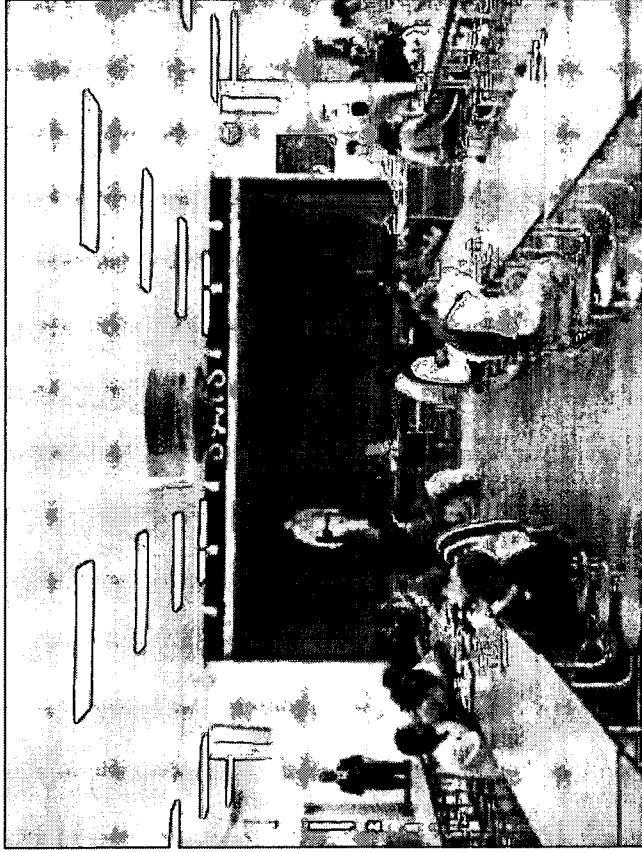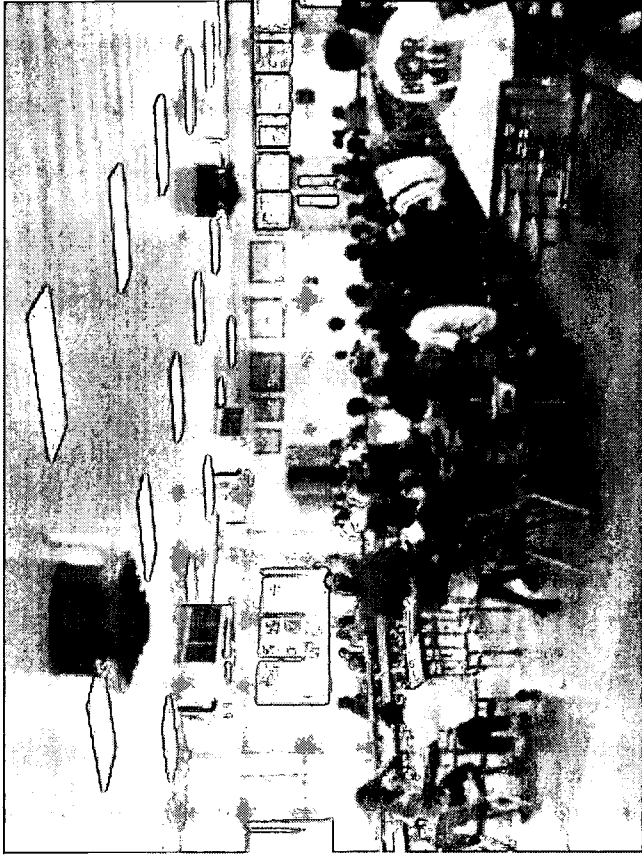


Shivers Junior/Senior High School


Photos – Gymnasium

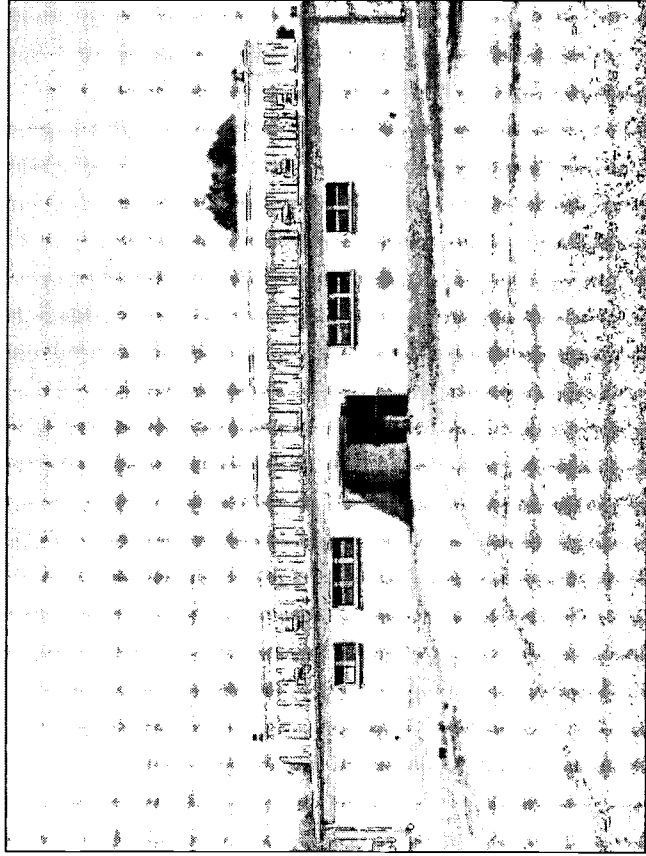

South Elevation

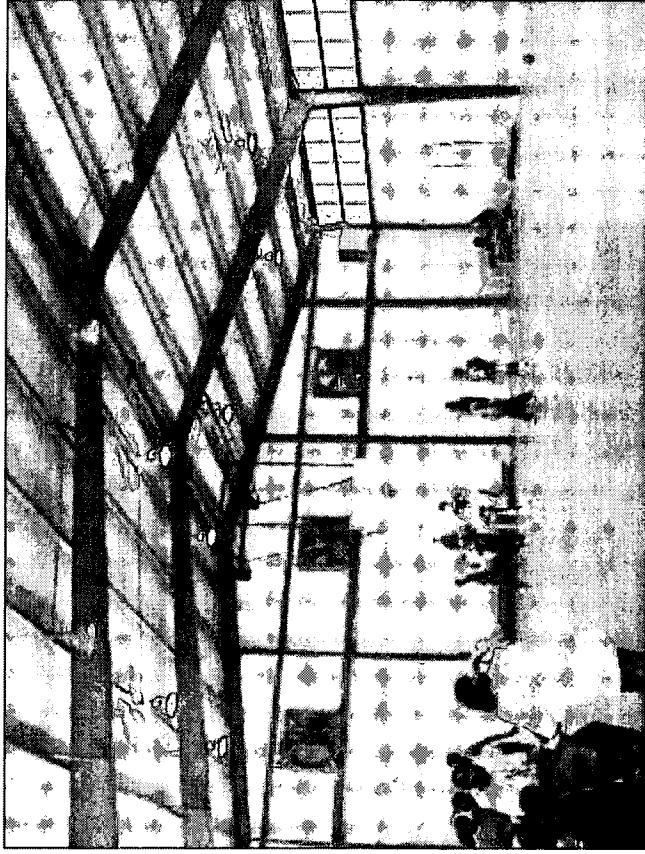

Interior

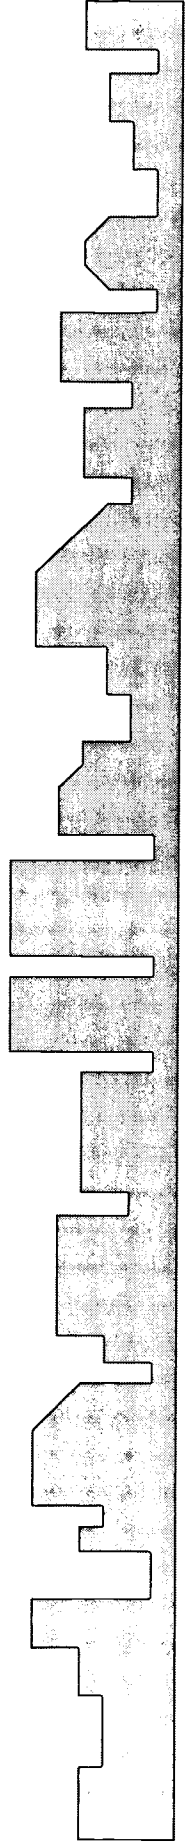


Shivers Junior/Senior High School

Current Energy Use:

Energy Source	Annual Energy Use - \$\$	Energy Use Category	Estimated Yearly Energy Use	
			% of total	Cost - \$\$
Natural Gas	\$4,600	Space Heating	68%	\$3,128
		Hot water heating	17%	\$782
		Cooking	13%	\$598
Electricity	\$21,750	Lighting	58%	\$12,615
		Cooling	20%	\$4,350
		Equipment	9%	\$1,958
		Fans/motors	7%	\$1,523
		Refrigeration & cooking	4%	\$870
		Water Heating	2%	\$435
TOTAL				\$26,258


divided by 45,000 sf = \$0.58 /sf
 Average school uses -> \$1.20 /sf

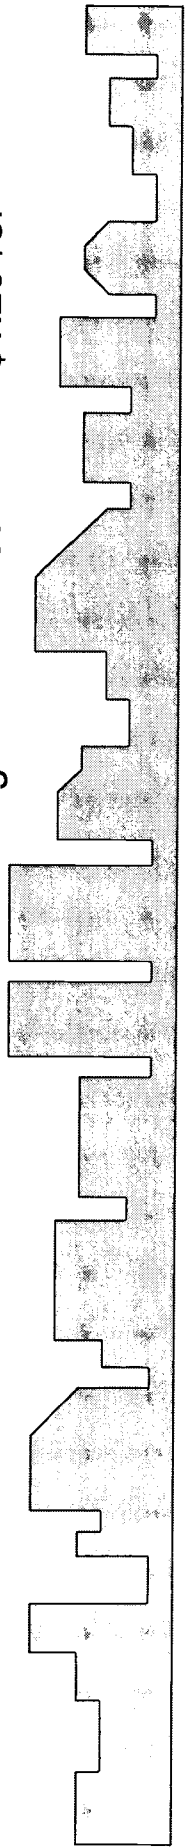


Shivers Junior/Senior High School

Opportunities for improvement:


- Inefficient HVAC systems

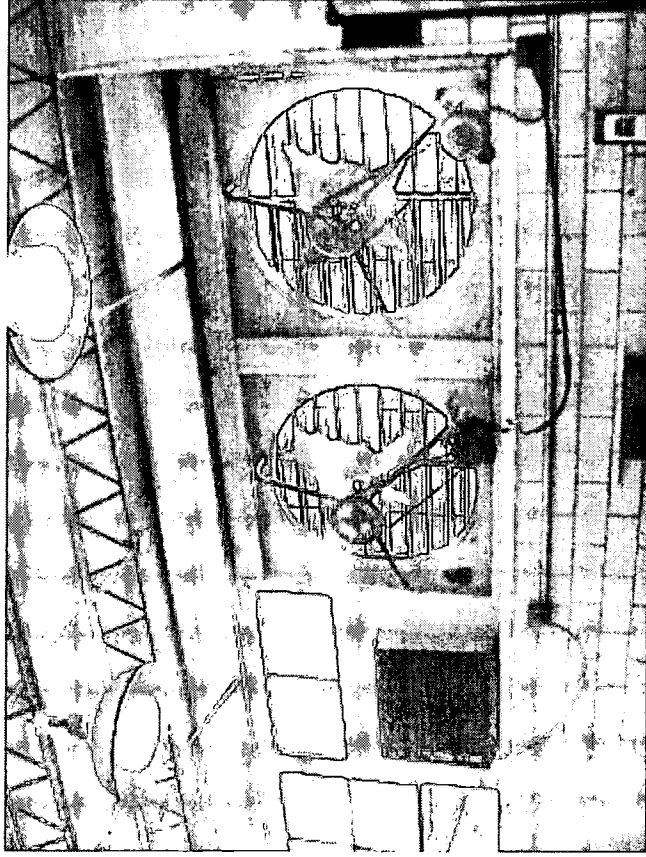

Window AC units w/ vent fans

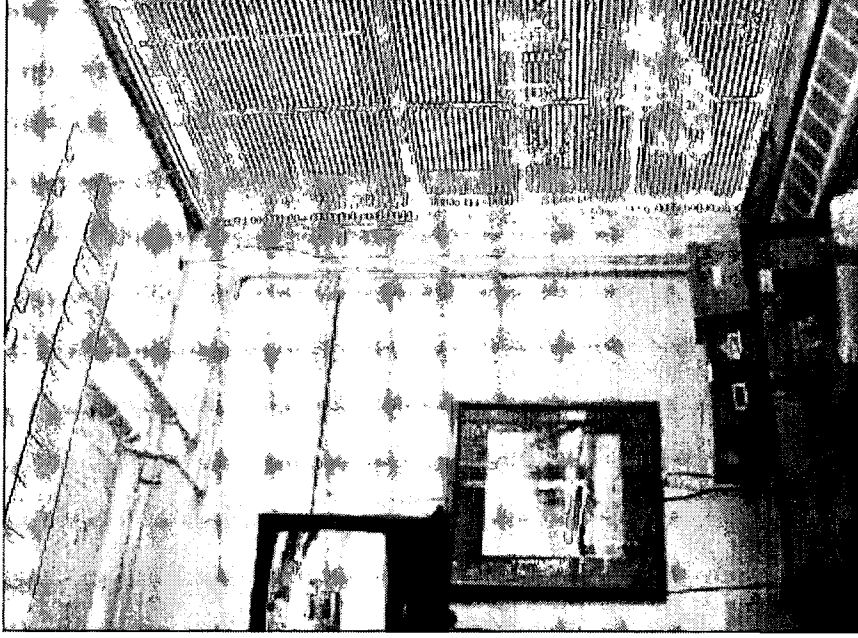



Hot water fan coil units

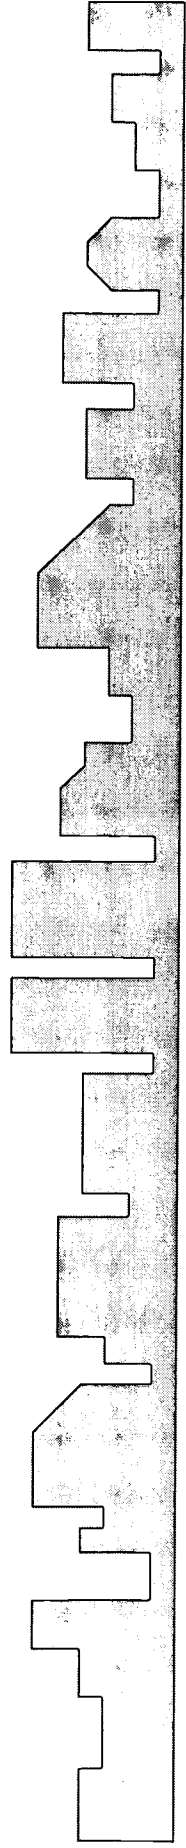

Shivers Junior/Senior High School

Opportunities for improvement:



- Inadequate ventilation when cooling – ventilation option closed on window AC units
- Leaky envelope

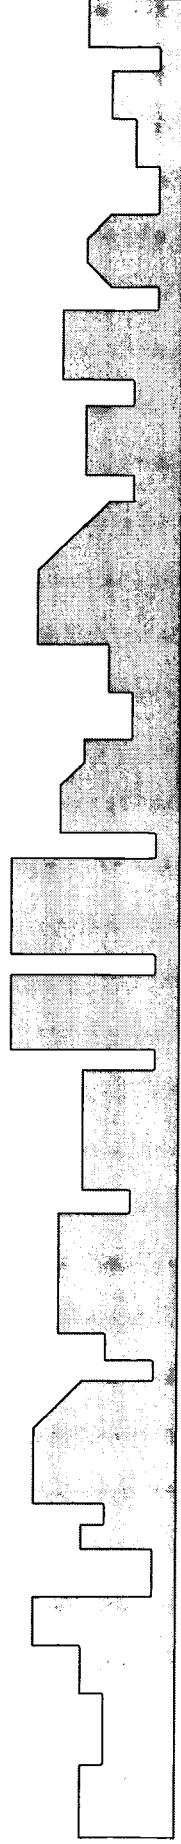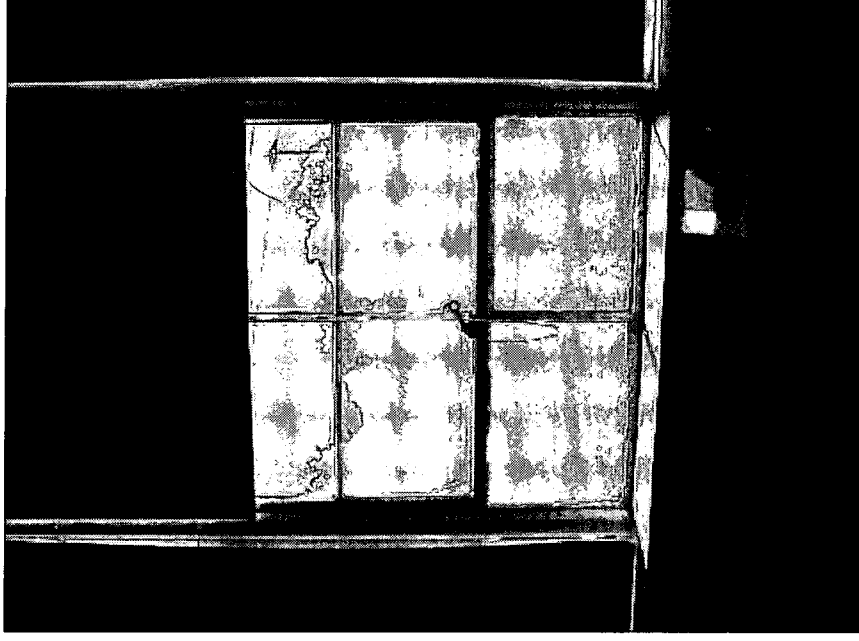

Shivers Junior/Senior High School

Opportunities for improvement:



- Excessive glare in classrooms – blinds shut most of time

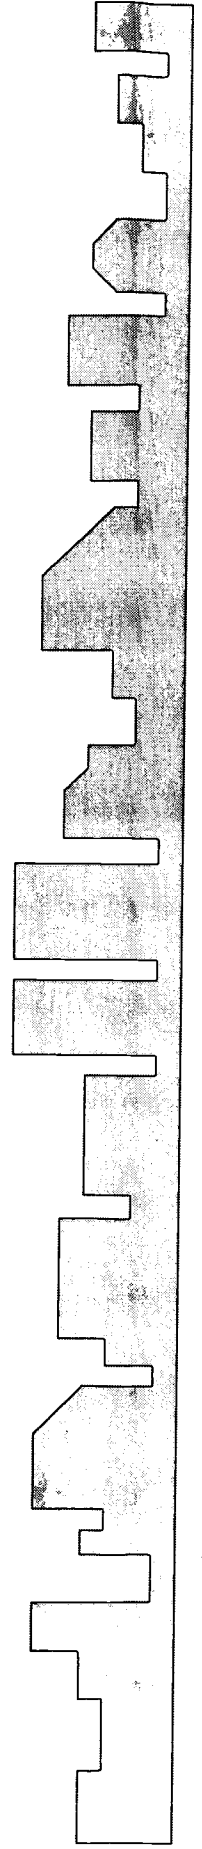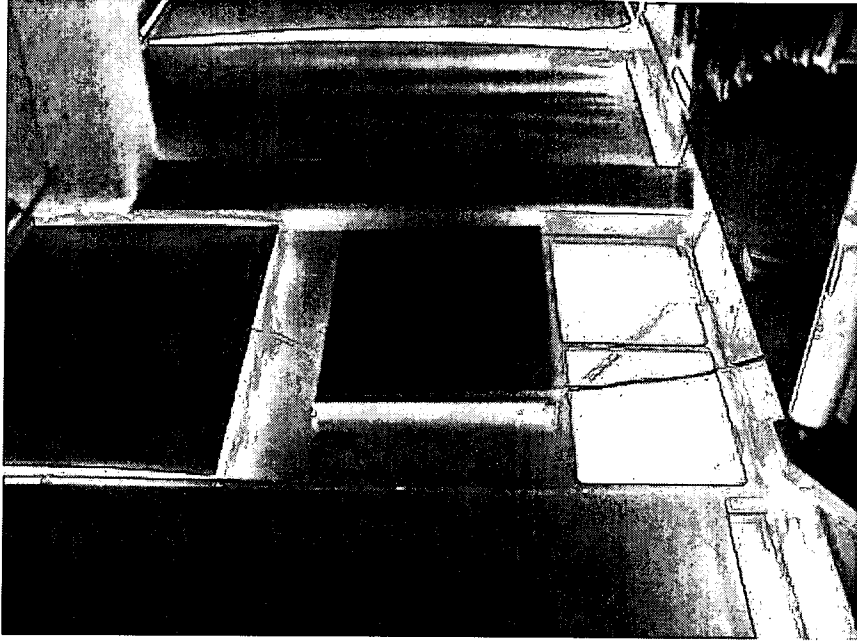

Shivers Junior/Senior High School

Opportunities for improvement:


- Poor hallway lighting

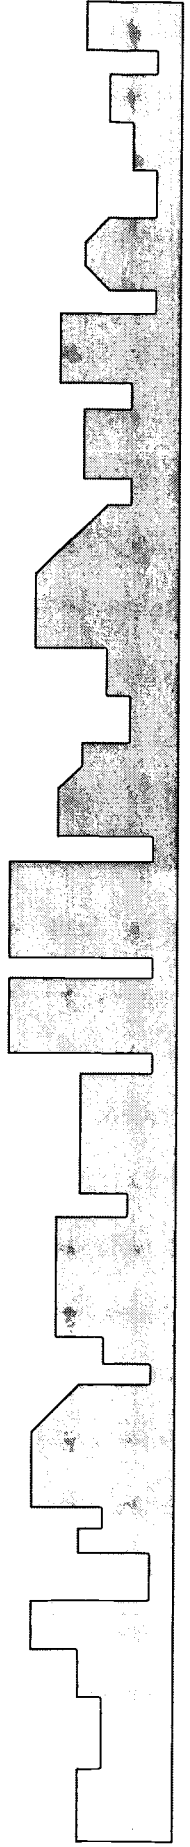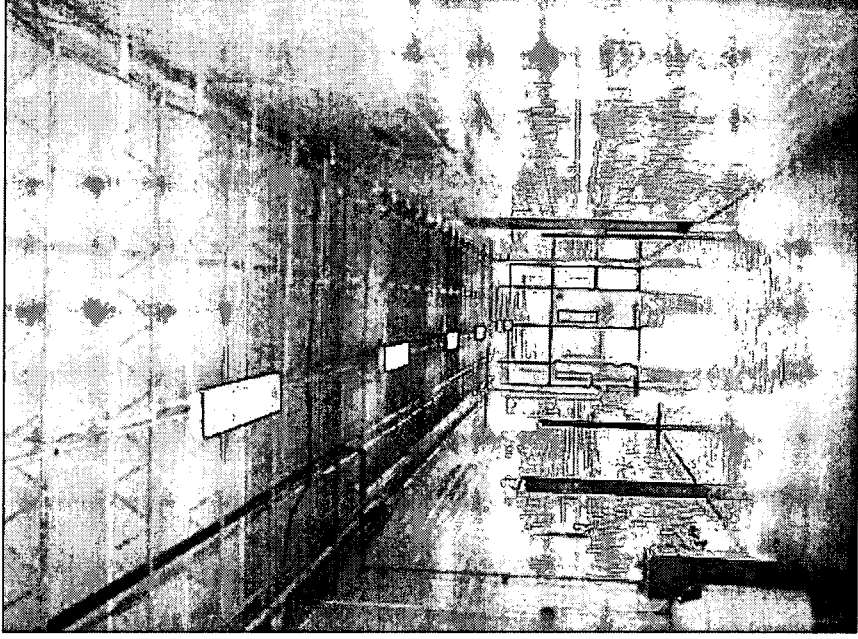


Shivers Junior/Senior High School

Opportunities for improvement:


- Poor inefficient lighting

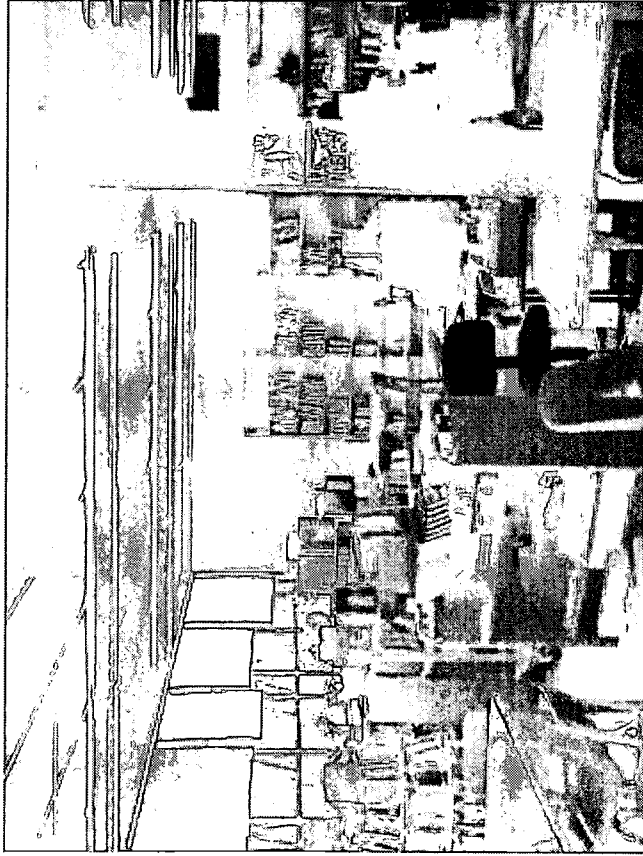

Library lighting

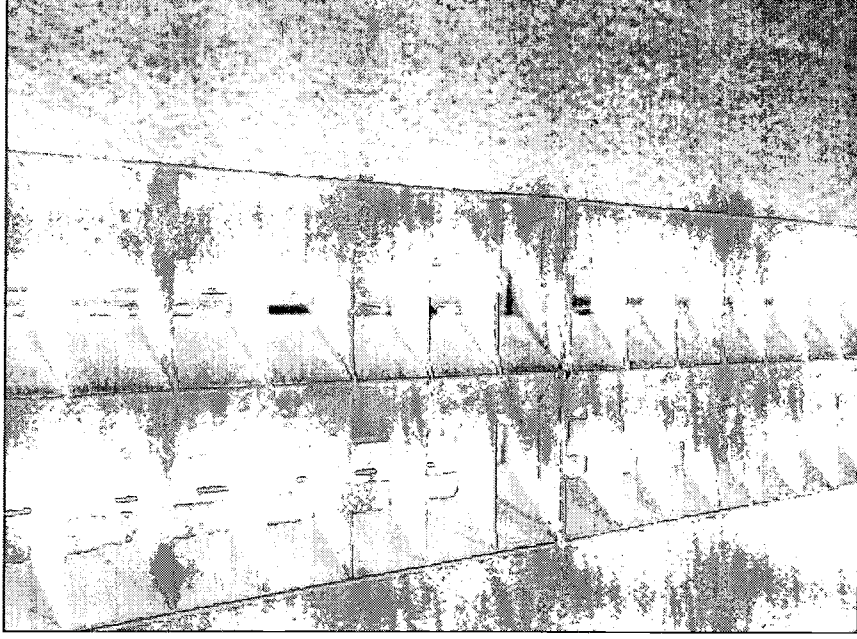



1950 fluorescent light fixtures

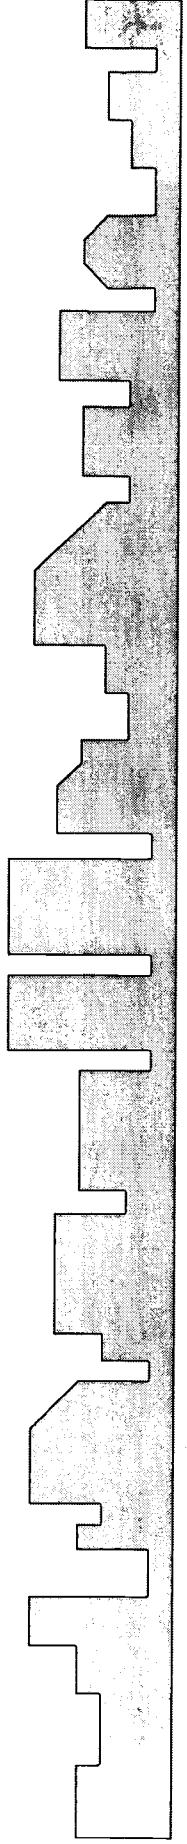

Shivers Junior/Senior High School




Opportunities for improvement:

- Inadequate electrical wiring in classrooms for computers and other equipment

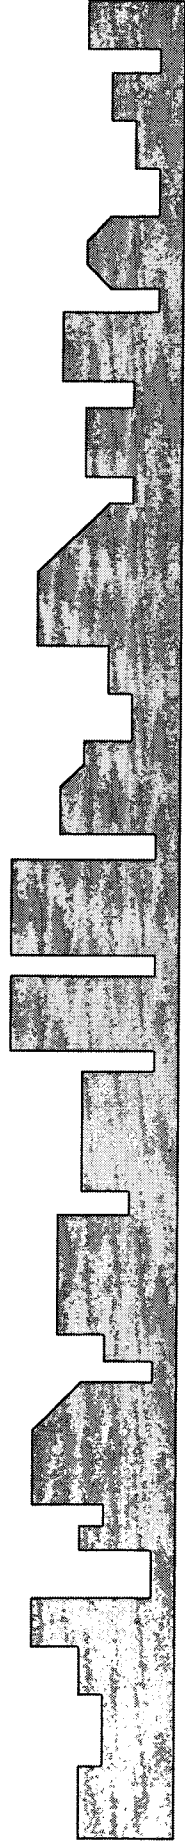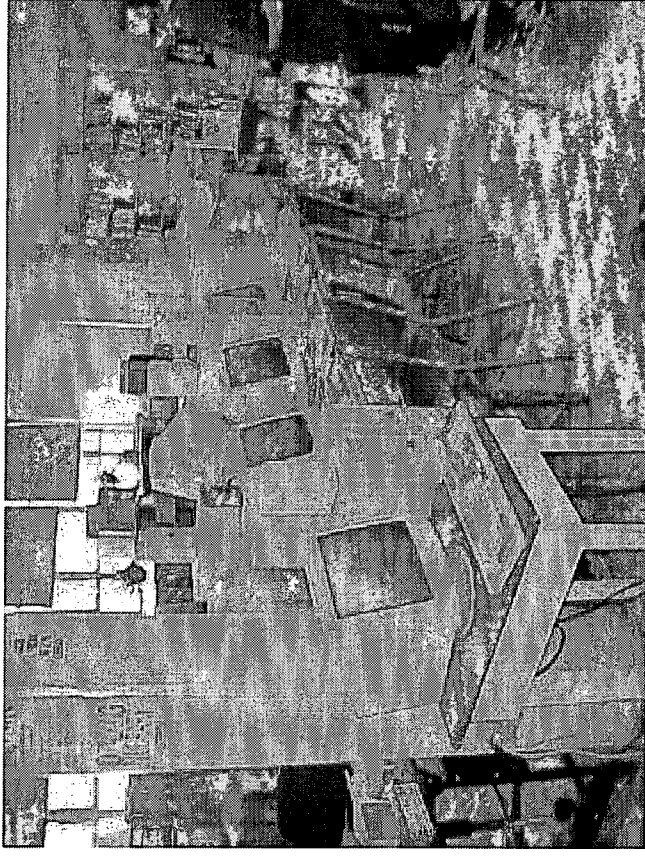

Shivers Junior/Senior High School

Lighting Retrofit – LED exit lights

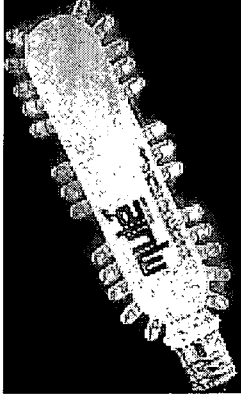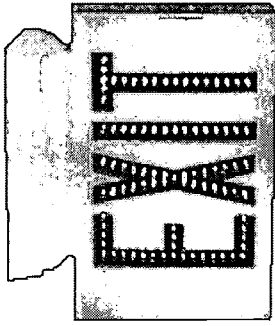

a	b	c	d=b x c	e=a x d/1000	=e x \$0.0805/Kwh	\$s/year
Watts per sign	Hours use per day	Days/yr	Total Hours	Total Kwh/yr		
20	24	365	8760	175		\$14
2	24	365	8760	18		\$1
Standard Exit Sign					SAVINGS/year	\$13
LED Exit sign					Labor savings	\$20
					TOTAL SAVINGS	\$33

Cost Analysis

a	b	c=b/a
SAVINGS	Cost of LED lamps	Payback-years
\$33	\$22	0.7

Shivers Junior/Senior High School Lighting Retrofit – T8 lamps & Electronic Ballasts

Number of fixtures

a	b	c=a x b	d	=c/d
Floor area lit by fluor.	Existing watts/sf	Total Watts	Watts/fixture 2-4' lamps & Mag ballast	No. of Fixtures
45000	1.6	72000	84	857

Annual Energy Use - Existing Lighting System

a	b	c=a x b	d	e	f	g=c x d x e x f/1000	=g x \$0.0805/Kwh
No. of Fixtures	Watts/fixture 2-4' lamps & Mag ballast	Total Watts	Hours day	Days Week	Weeks Year	Kwh Year	\$/year
857	84	72,000	10	5	44	158,400	\$12,751

Annual Energy Use - Efficient Lighting System - T8 lamps + electronic ballasts

a	b	c=a x b	d	e	f	g=c x d x e x f/1000	=g x \$0.0805/Kwh
No. of Fixtures	Watts/fixture 2-4' T-8 lamps & elec. ballast	Total Watts	Hours day	Days Week	Weeks Year	Kwh Year	\$/year
857	53	45,429	10	5	44	99,943	\$8,045

Cost Analysis



a	b	c	d	e	f=a x (b+c+d+e)
No. of Fixtures	Lamp cost per fixture	Electronic Ballast Cost	Ballast & Lamp recycling Cost	Labor to retrofit fixture	Total Cost
857	\$4.00	\$18.00	\$5.40	\$15.00	\$36,343

Net savings	\$4,706
-------------	---------


cost/savings	Payback - years
	7.7

Shivers Junior/Senior High School



Lighting Retrofit – Daylighting

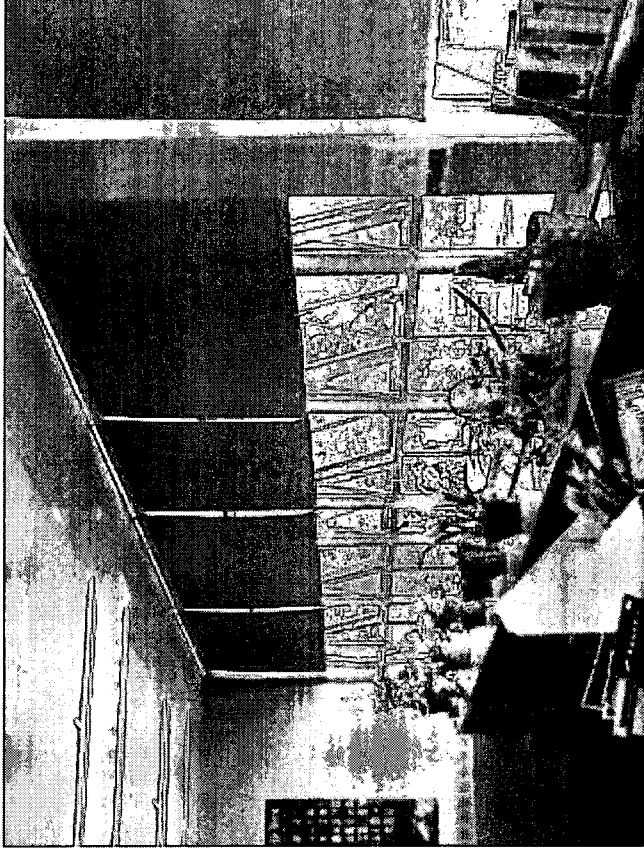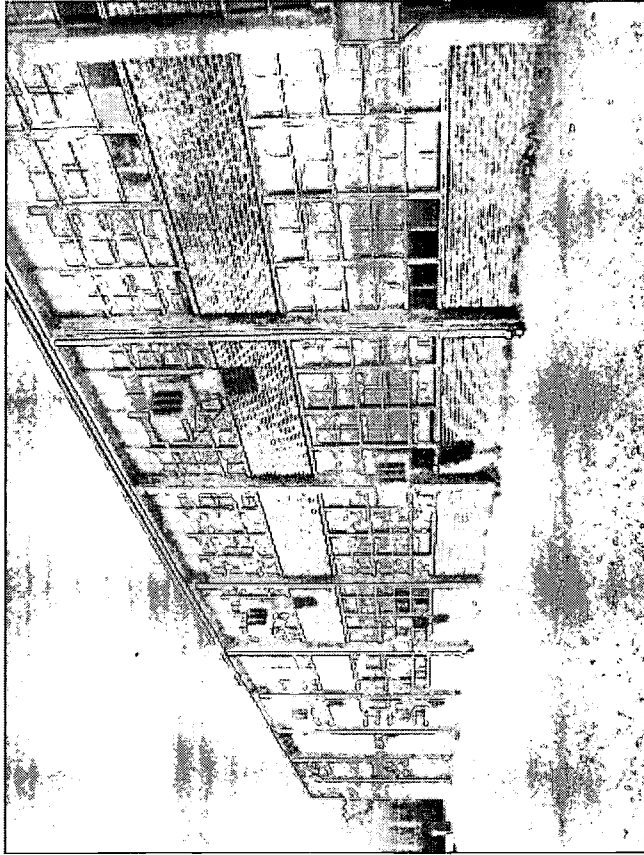

Blinds are shut on almost all the windows because of solar heat gain & glare

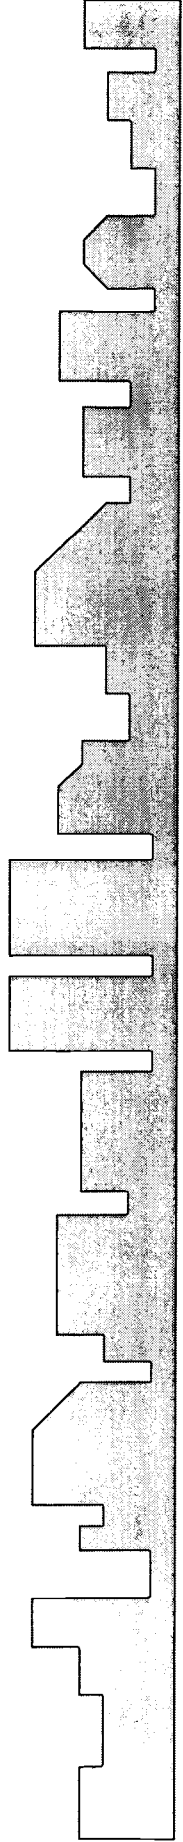

Lighting Retrofit – Daylighting

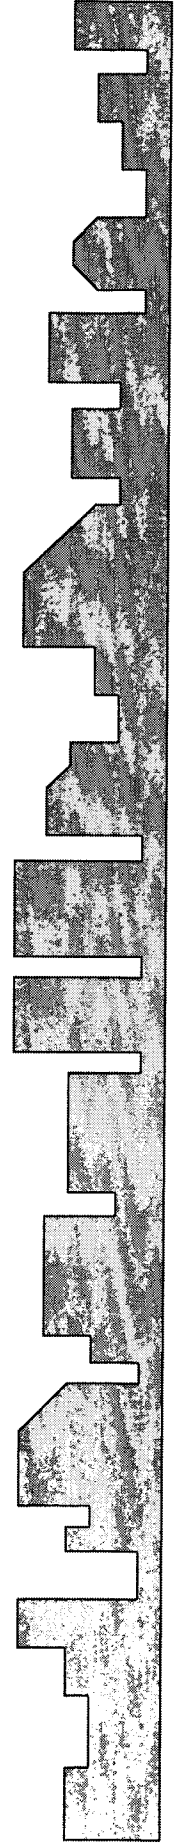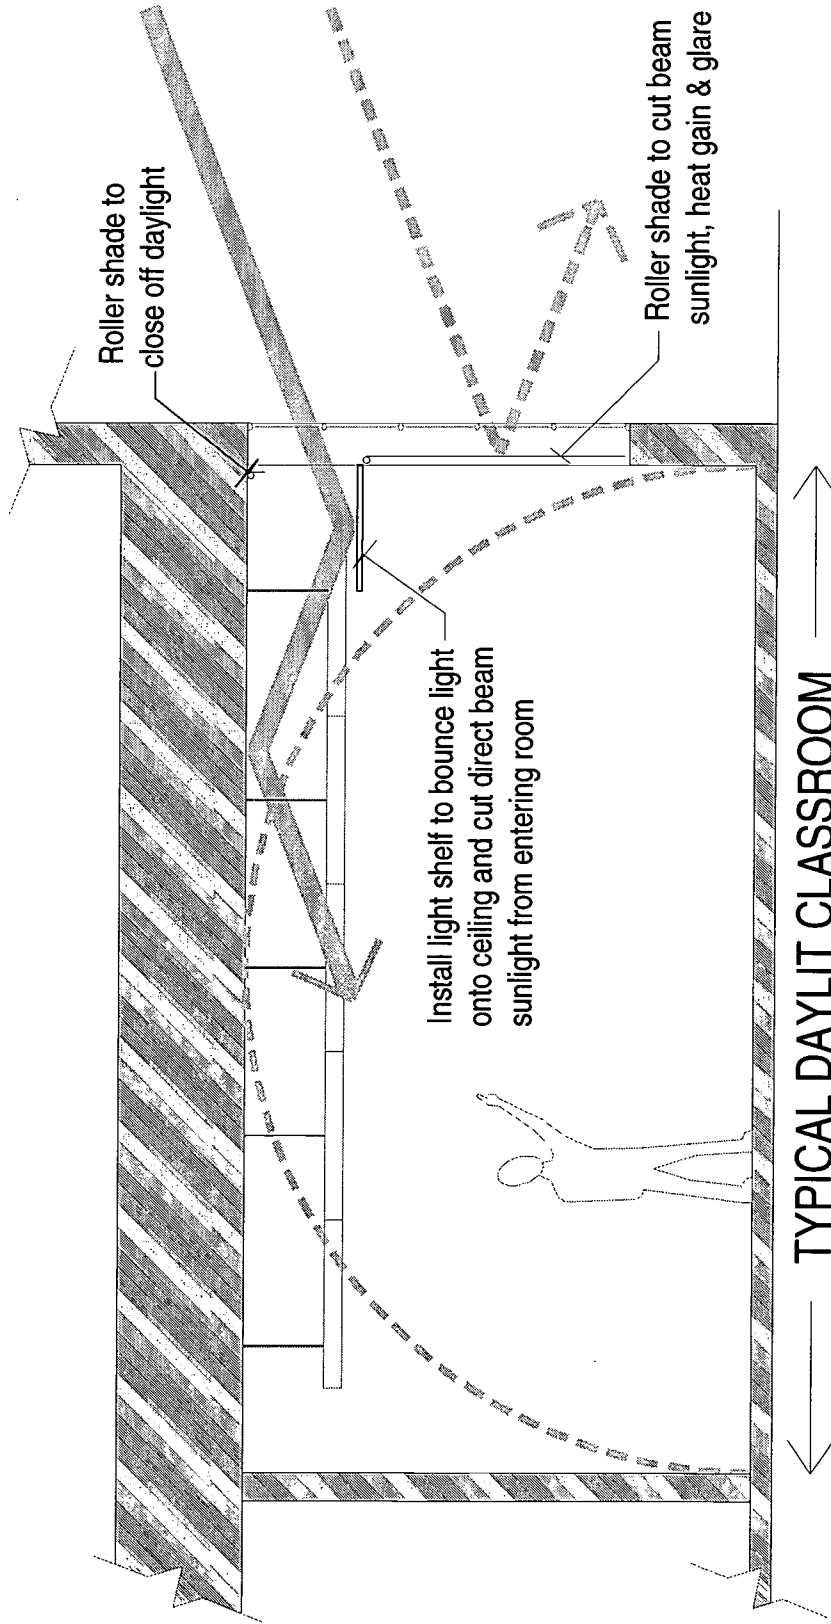

Shivers Junior/Senior High School

Lighting Retrofit – Daylighting


Daylight savings

a	b	c = b x 45,000	d = a x b	e	f = d x e
\$/year spent on lighting	% of building that could be retrofitted for daylighting	sq ft of bldg that could be retrofitted for daylighting	\$/year lighting that could be impacted by daylighting	% savings due to daylighting	Potential Daylit savings
\$12,615	30%	13,500	\$3,785	60%	\$2,271

Cost Analysis



b=19 class rooms x 28' c=19 class rooms x 28'
 3' x \$4.50/sf x2.5' x \$1.76/sf

a	b	c	d = b + c	c = b/a
SAVINGS	Cost of light shelves	Cost of upper roller shades above light shelves	Total Cost	Payback-years
\$2,271	\$7,182	\$2,341	9,523	4.2

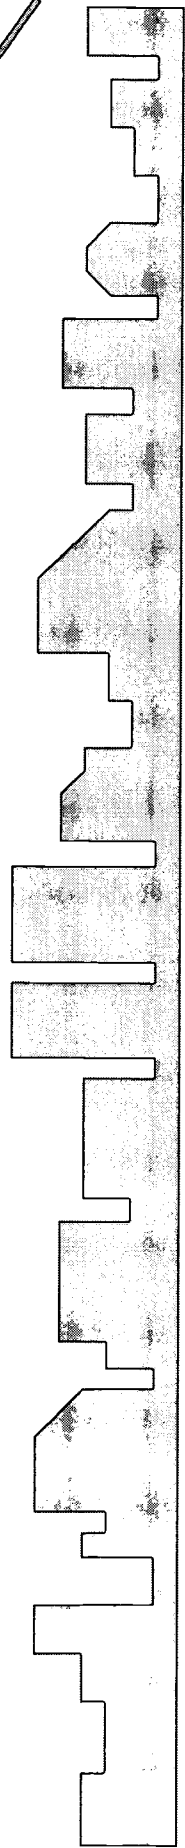

HVAC Retrofit – Geothermal Heat Pump

- Transfers heat out of the ground and into the classrooms in winter.
- Transfers coolness out of the ground and into the classrooms in summer.
- Very efficient and very environmental HVAC System.
- Uses minimum amounts of space, no boiler and chiller.
- Low maintenance

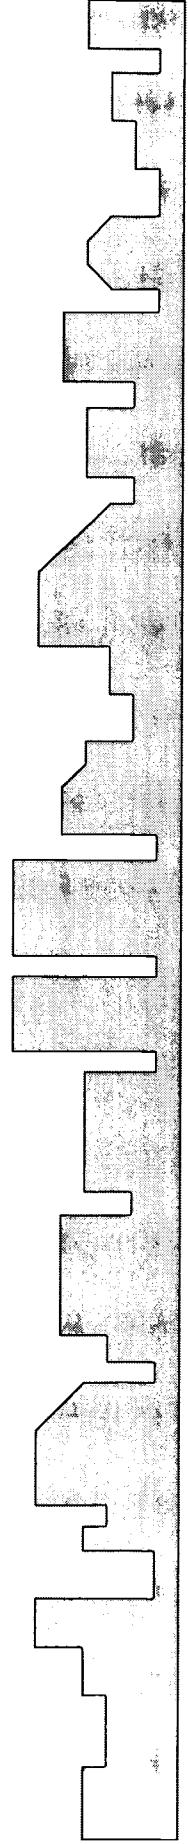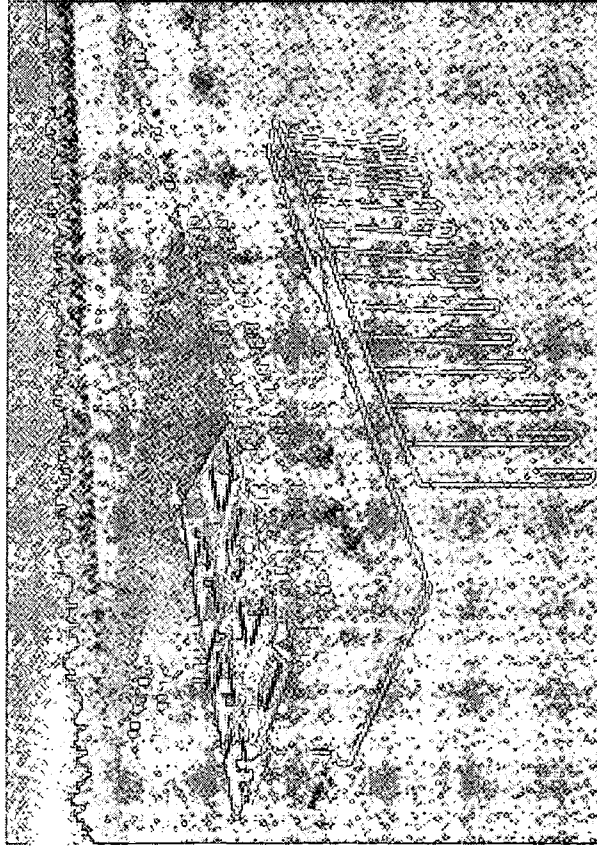

Shivers Junior/Senior High School HVAC Retrofit – Geothermal Heat Pump

Geothermal heatpump savings

a	b	c	d	e = b x c	f	g = a x f	h = e + g
sq ft	Total Energy Cost/year	Heating & cooling Cost/year	Average Geothermal savings-%	Potential Yearly savings-\$	Typical Maint. Savings \$/sf	Yearly Maint. Savings \$s	Total Savings
Shivers High School	45,000	\$7,478	40%	\$2,991	\$0.05	\$2,250	\$5,241

Geothermal Heatpump Cost

School	Year Built	Climate	HDD	CDD	sq ft	a	b	c = b/a	Tons	Tons/sf
Boone High School	1971	Tri-Cities	4306	1107	161,000		451,000	2.80	400	403
Shivers High School	1956	Jackson, MS	2300	2316	45,000		126,056	2.80	112	403

d = a x c
 -calculated for Shivers

Cost Analysis


a	b	c = b/a
SAVINGS	Cost of geothermal System	Payback -years
\$5,241	\$126,056	24

Shivers Junior/Senior High School




Other Energy Conservation Opportunities to consider:

- Occupancy sensors – quick payback
- Exterior Shade Screens – quick payback
- Night setback and setup thermostats – quick payback
- Roof insulation / light colored roof – cost effective during re-roofing
- Wall insulation – very long payback
- Insulated windows – interior storm windows – medium payback, new windows – very long payback

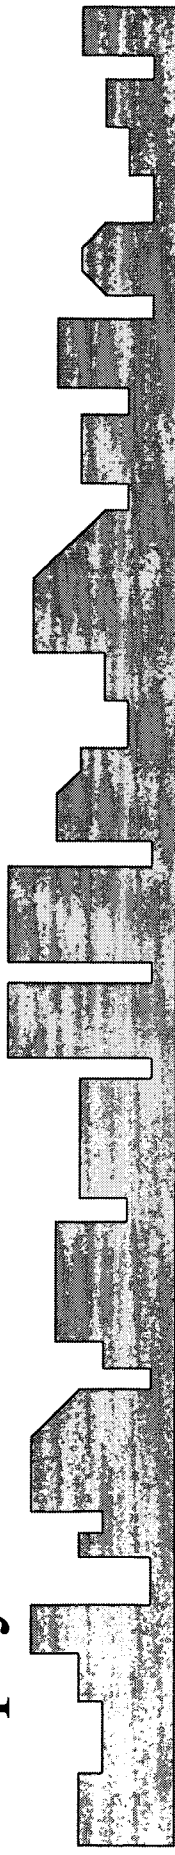

Summary:

- Need to reuse existing buildings and existing brown field sites.
- When we upgrade buildings we need to make them more functional and energy efficient.
- If we do have to build new we need to recycle materials and chose more sustainable building materials.

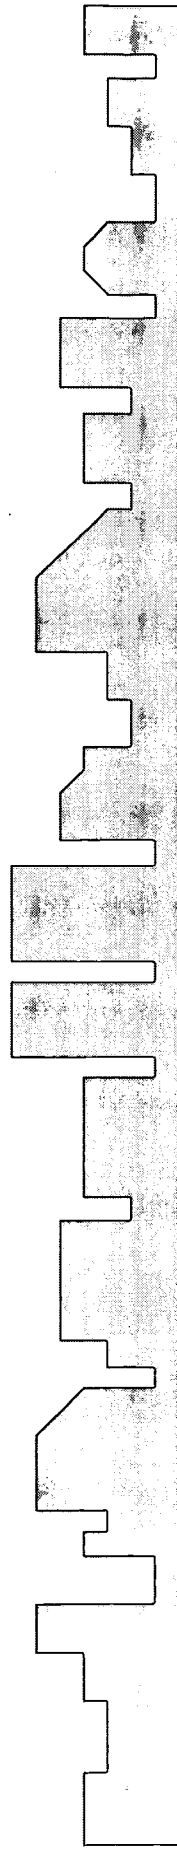



U.S. Department of Education
Office of Educational Research and Improvement (OERI)
National Library of Education (NLE)
Educational Resources Information Center (ERIC)



NOTICE

REPRODUCTION BASIS



This document is covered by a signed “Reproduction Release (Blanket) form (on file within the ERIC system), encompassing all or classes of documents from its source organization and, therefore, does not require a “Specific Document” Release form.



This document is Federally-funded, or carries its own permission to reproduce, or is otherwise in the public domain and, therefore, may be reproduced by ERIC without a signed Reproduction Release form (either “Specific Document” or “Blanket”).