

CO2LD: AN EDUCATIONAL INNOVATION PROJECT FOR ADVANCED VOCATIONAL TRAINING IN REFRIGERATION**Daniel Sánchez¹, Rodrigo Llopis¹, Jorge Patiño¹, Ramón Cabello¹, Enrique Torrella²**¹Department of Mechanical Engineering and Construction, Universitat Jaume I (Spain)²Department of Applied Thermodynamics, Polytechnic University of Valencia (Spain)sanchezd@uji.es, rllolis@uji.es, jpatino@uji.es, cabello@uji.es, torrella@ter.upv.es*Received June 2013**Accepted September 2013***Abstract**

Refrigeration is one of the technology sectors that has suffered the most changes in the last twenty years, because of the negative impact of the fluids used in the refrigeration cycles, i.e., refrigerants, due to their impact on the ozone layer and their contribution to global warming. As a result of their negative effects, the European Union has established several directives to restrict the use of refrigerant fluids, and the sector therefore needs to adapt to the new regulations.

This process of adaptation of the refrigeration sector to the new regulations must be carried out by all the agents involved, including those engaged in the training and education of the future refrigeration technicians. To allow this to be accomplished, a project called CO2LD was developed to introduce the future technology in High Degree Professional Training in Refrigeration. The objective of the project consisted in introducing more efficient and more sustainable refrigeration systems, namely R134a/CO₂ cascade cycles, into the Advanced Vocational Training in Refrigeration studies, and in creating a collaborative framework among students, secondary schools, refrigeration technicians, refrigeration companies, and the University in order to facilitate the transfer of know-how. This paper presents the objectives of the project, describes its development, and analyzes its main conclusions.

Keywords – advanced vocational training, refrigeration, cascade cycles, low GWP refrigerants

1 INTRODUCTION

Refrigeration, or the production of “artificial cold”, is a technology that is essential to guarantee the welfare of our society, for example in air-conditioning, refrigerated transport, refrigeration for preservation of perishables, industrial processes, and so forth. Thus, refrigeration has spread to all areas of our lives. In fact, in 2007 the electrical energy consumption of the refrigeration sector, including air-conditioning, accounted for 15% of the total electrical energy produced in the world (International Institute of Refrigeration, 2007). Moreover, in some applications, such as supermarkets, refrigeration and HVAC represent around 50% of the electrical energy consumption (Tassou, Ge, Hadaway & Marriott, 2011).

Achieving sustainable development is a global objective all around the world and, accordingly, increasing energy efficiency and using more environmentally friendly technologies is needed for any activity or process, both in industry and for domestic uses. The refrigeration sector must deal with both perspectives, since its energy consumption is continuously increasing with the spread of this technology in all human activities, and because the most common refrigerants are greenhouse gases. First, the electricity demanded by the refrigeration plants represents important emissions of the greenhouse gas CO₂, known as the ‘indirect effect’ of

refrigeration plants. Second, the most widespread refrigerants belong to the HFC family, which are classified as one of the six types of greenhouse gases (United Nations, 1997) and have a Global Warming Potential (GWP) thousands of times that of CO₂. The emission of these refrigerants into the atmosphere corresponds to the 'direct effect', representing another problem for the environment (Figure 1). Therefore, the use of low-GWP refrigerants must be considered.

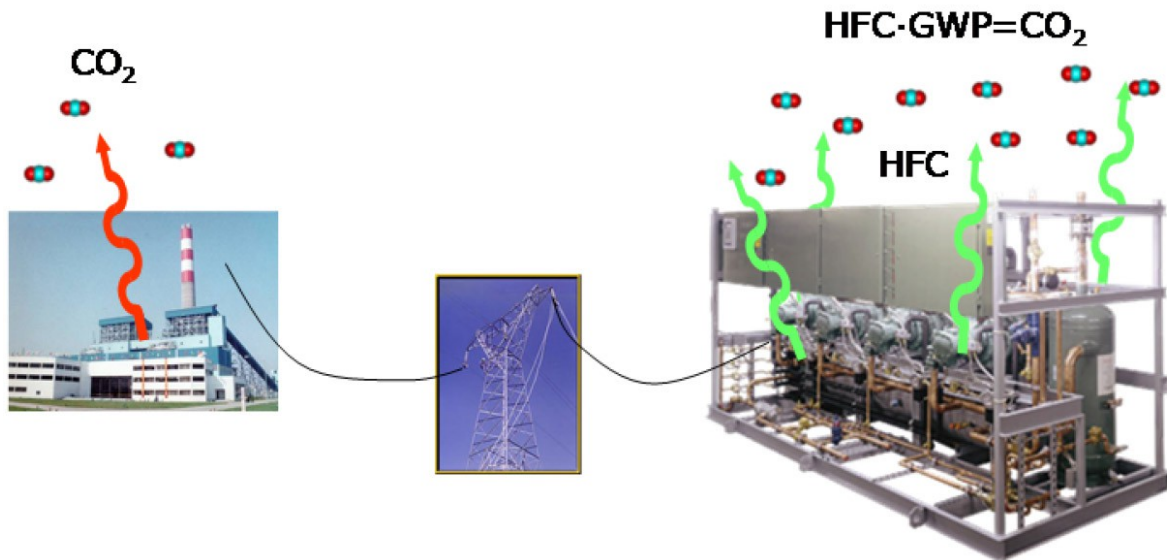


Figure 1. Outline of the environmental issues of refrigerating systems

In Europe legal measures have been introduced to restrict the use and emissions of fluorinated gases (like refrigerants with fluorine), such as Regulations CE-1484/2007, CE-842/2006, CE-40/2006 and CE-0189/2003, which were focused on limiting the use of refrigerants with high GWP values (above 150) in air-conditioning or refrigeration appliances. Additionally, the European Commission has presented the proposal of regulation COM/643/2012 (2012) on the regulation of fluorinated greenhouse gases, which include strong limitations on the use of HFC refrigerants. That proposal will mainly affect the refrigerants used in commercial refrigeration, i.e., R404A and R507A, as of the year 2020.

This last proposal for regulation, if approved, will call for a profound renewal of refrigeration technology and its refrigerants in order to achieve the following goals:

- Use of more environmentally friendly refrigerants. Among these refrigerants CO₂ stands out above the rest because of its environmental properties (ODP=0, GWP=1), its safety characteristics (non-toxic, non-inflammable, non-explosive) and its thermophysical properties (high heat transfer coefficients).
- Implementation of more energy-efficient refrigeration systems. In this line, in refrigeration at medium and low evaporating temperatures, double-stage refrigeration systems, either as compound (Torrella, Llopis & Cabello, 2009), booster (Mumanachit, Reindl & Nellis, 2012) or cascade systems (Dopazo & Fernández-Seara, 2011; Getu & Bansal, 2008), are being used more and more frequently. This project focuses on the application of cascade systems with low-GWP refrigerants.

To comply with the above objectives a number of important barriers need to be surmounted (McMullan, 2002), among which we could highlight the need for education, training, and awareness of the use of new refrigerants and the new technologies associated with them, which differ greatly from those currently in use. To overcome these barriers, the main objective of the project entitled '*CO2LD: New vapour compression refrigeration technologies using CO₂ and R134a to replace the current fluorinated refrigerants (HFC)*' was to introduce these new refrigeration systems and the new refrigerants in the 'Advanced Vocational Training in Refrigeration' and at the same time create a collaborative framework among the instructors, the sector companies, and the University to facilitate the implementation of these refrigeration systems. Each part of the framework performed a vital role in ensuring the success of the project: the University carried out a process of technology transfer, the companies provided the technology, and the high school teachers were instructed so as to be able to teach the future technicians in refrigeration.

2 PROJECT APPROACH

To fulfill the goal of the project mentioned in Section 1, the project was organized in such a way as to allow the following sub-objectives to be fulfilled:

- Achieve a common forum to allow knowledge to be transferred among all the parts involved in the project. To accomplish this, collaboration between the University and the Companies was established in order to attain a process of knowledge transfer to the instructors and students of the Advanced Vocational Training.
- Design, build, and develop a refrigeration system in each participating school. The plants were based on the cascade technology, the selected fluids being CO₂ and R134a, since their combination was one which provided a low GWP solution and, at the same time, high energy efficiency.
- Provide measurement devices and a data acquisition system in each plant in order to be able to evaluate the energy performance of their operating cycle. This was absolutely necessary to complete the process of instructing the future technicians.
- Build and launch a website and a virtual classroom to make the results and development of this project, including the equipment that was implemented, knowledge and results, accessible to other educational institutions that are related with refrigeration but were not able to participate in this project.
- Embody all the project results and the process of knowledge transfer in educational documentation to be used as a support for the practical and theoretical lessons that are taught in the high schools.
- Instruct the advanced vocational training teachers about automation, measurement, regulation, and control techniques of complex refrigeration plants. Furthermore, they were also to be instructed about new refrigeration methods which are being introduced in the industrial field.
- Disseminate the project results through specialized means of communication in the refrigeration sector, both from the point of view of education and from the point of view of industry. A good, strong involvement on the part of the sector companies in the results of the project is essential.

3 PROJECT METHODOLOGY

To achieve the objectives of the project, the methodology used, and summarized in Figure 2, was the following:

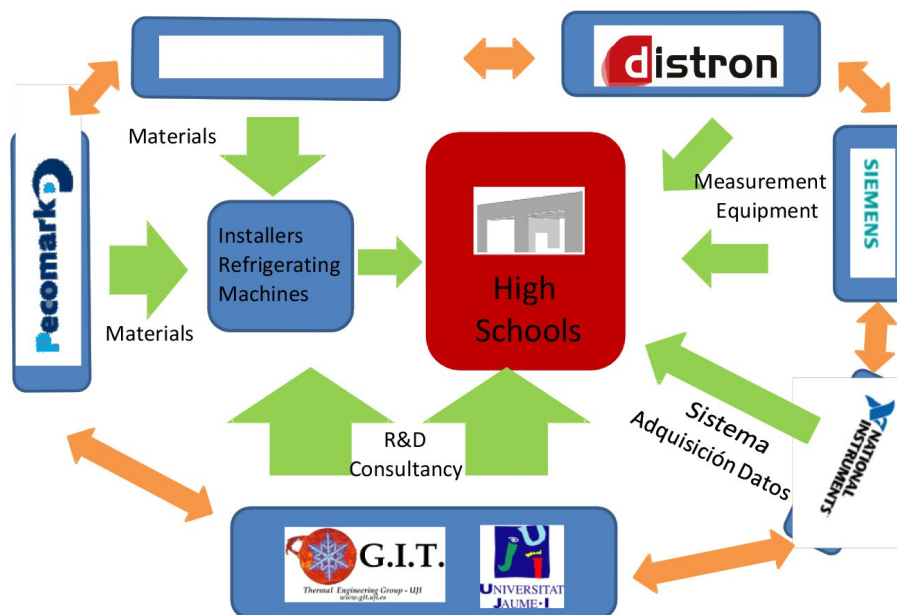


Figure 2. Map of the collaboration among agents involved in the project

The Thermal Engineering Research Group (www.git.uji.es) from the Universitat Jaume I of Castellón planned and designed the cascade refrigeration system, with the support of the companies Frost-Trol S.A. (www.frost-trol.com) and Pecomark S.A. (www.pecomark.com). All the components of the refrigeration system were provided by Pecomark Levante and Pecomark Andalucía, and Frost-Trol S.A. supplied the refrigerated cabinets to provide the system with the refrigeration load.

The companies DISTRON S.L. (www.distron.es) and Suelcasa S.A. (www.suelcasa.com) supplied the electrical components and measurement devices to monitor the refrigeration plants. Those components, together with the data acquisition systems provided by National Instruments (spain.ni.com), comprised the Data Acquisition System used to monitor the plants. Furthermore, the Thermal Engineering Research Group developed a data acquisition system based on LabView to be able to analyze the energy performance of the plants.

The refrigeration plants, with the measurement devices, were built by Pecomark and sent to the refrigeration installers to complete the whole refrigeration system in each participating school (IES Rascanya-Antonio Cañuelo, Valencia; IES Salvador Victoria, Monreal del Campo, Teruel; IES el Valle, Jaén; IES Pou Clar, Ontinyent, Valencia).

Throughout the whole of the project, the University, companies, and school staff collaborated in all the phases of the project, establishing a thematic network to analyze the advances being made in the project. Periodically, congresses and specific seminars were held in order to achieve knowledge transfer among all the agents involved.

4 PROJECT DEVELOPMENT

The project started in November 2011 and ended in October 2012, the main activities being the following:

- An initial training week to deal with the possible consequences of the modifications to the regulations, to instruct the participants in the use of CO₂ in refrigeration plants, and to study several energy efficiency techniques in refrigeration plants (Figure 3). This training week was held in December 2011 at the IES Rascanya, in Valencia, Spain. The conferences were open to installers, students, and everybody participating in the project.

JORNADES 12/16 DESEMBRE
CO₂ LD
 TECNOLOGIA PER A LA REFRIGERACIÓ AMB CO₂
 Presentació i desenvolupament tecnològic del CO₂ com refrigerant respectuós amb el Medi Ambient

JORNADES 12/16 DESEMBRE
Tecnología de refrigeración per CO₂
 Presentació i desenvolupament tecnològic del CO₂ com refrigerant respectuós amb el Medi Ambient

DIMECRES 14 de desembre 2011
 JORNADA PER A PROFESSORS, INSTAL·LADORS I ALUMNES AVANTATJATS.
PONÈNCIA 1: Sistemes de regulació de la condensació, condensació flotante PECOFLDT.
 PONENTS: SR. ALBERT ALBERT I SR. JORDI CABELLO, DE PECOMARK.
PONÈNCIA 2: Sistemes de regulació de la carga en centrals frigoríficas, sistemes mecànics vs variador de frecuencia.
 PONENTS: SR. ALBERT ALBERT I SR. JORDI CABELLO, DE PECOMARK.

DIJOUS 15 de desembre 2011
 JORNADA PER A PROFESSORS, INSTAL·LADORS I ALUMNES AVANTATJATS.
PONÈNCIA 1: Criterios de dimensionamiento y montaje de líneas frigoríficas i de muebles frigoríficos en supermercados.
 PONENTS: SR. ENLLO MARTORELL I SR. ÀNGEL BUENO, INSTAL·LADORS FRIGORÍFICS.
PONÈNCIA 2: Muebles frigoríficos: tipologies, característiques de disseny e influència de condicions ambientales sobre su comportamiento energético.
 PONENT: SR. JAVIER BLANCO CASTRO, DE FROST TROL.

DIVENDRES 16 de desembre 2011
 JORNADA PER A PROFESSORS, INSTAL·LADORS I ALUMNES AVANTATJATS.
PONÈNCIA 1: Experiencias con instalaciones frigoríficas que utilizan el CO₂ como refrigerante en régimen transcritical.
 PONENTS: PROFESSORS DEL GRUP D'INGENYERIA TÈCNICA DE LA UNIVERSITAT JAUME I DE CASTELLÓ - UNIVERSITAT POLITÈCNICA DE VALÈNCIA.
PONÈNCIA 2: Técnicas de desescarche en centrales frigoríficas.
 PONENT: SR. FELIX SAND, DE DANFOS.

CLAUJURA 13-30 h

IES Rascanya // Antonio Cañuelo

Figure 3. Conference leaflet about refrigeration fundamentals, regulation, and refrigerant fluids

- A second training week, held in March 2012 at the IES Rascanya, Valencia, about the energy monitoring of refrigeration plants. This week covered sensors, data acquisition systems, automation systems, and the software needed to handle all the information received by the measurement devices.
- A third training week, held in April 2012 in the laboratories of the Thermal Engineering Research Group in Castellón, Spain, and at the IES Rascanya, was about research methodologies with refrigeration plants and their automation.
- In parallel with the training sessions, the cascade refrigeration systems were designed, their schematic outline being that presented in Figure 4.

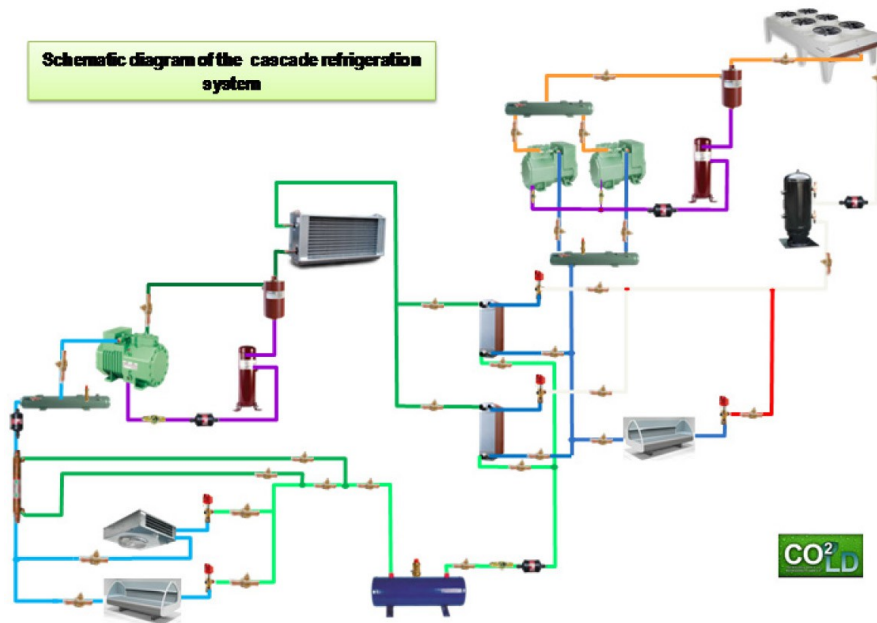


Figure 4. Schematic diagram of the design of the cascade refrigeration systems

- Technical visits to the participating companies. A visit to Pecomark Industrial in Barcelona and a visit to Bitzer in Germany were arranged (Figure 5).

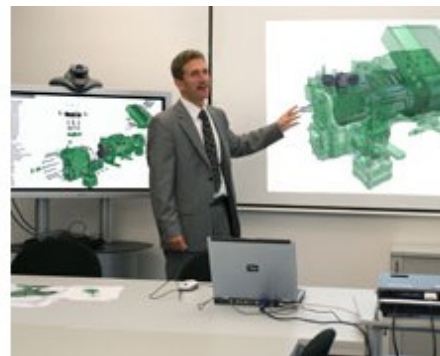


Figure 5. Visit to Pecomark Industrial in Barcelona (left) and to Bitzer in Stuttgart, Germany (right)

- Before the school's refrigeration plants were finished, some previous technical issues were tested in an experimental CO₂/R134a cascade in the laboratories of the Thermal Engineering Research Group, in Castellón (Figure 6). Accordingly, several technological solutions were tested successfully and were then implemented in the other cascade plants.



Figure 6. Experimental CO₂/R134a cascade at the Universitat Jaume I

- Once the refrigeration plants were finished at Pecomark’s plant, they were sent to each participating school to be installed by the refrigeration installers (Figure 7). The refrigeration plants were connected to the refrigerated cabinets and to the air condenser, the electrical box, and all the elements were connected and the data acquisition system was installed (Figure 8).

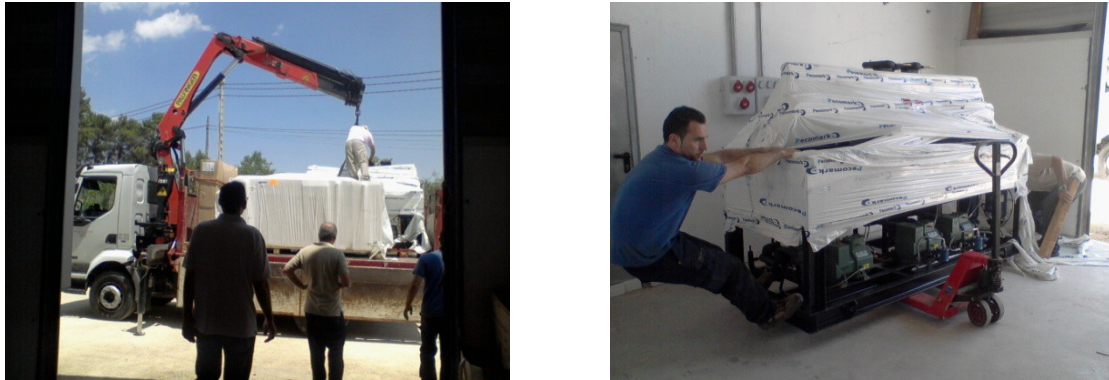


Figure 7. Arrival of the cascade refrigeration plant



Figure 8. Refrigerated cabinet (left), electrical box (center), DAQ system (right)

- The next fundamental activity was performed by the Thermal Engineering Research Group of Castellón, and consisted in developing the software for the real-time monitoring of the plants. This software, developed with LabView, was able to represent the operating thermodynamic cycle of the plants as they were running (Figure 9).

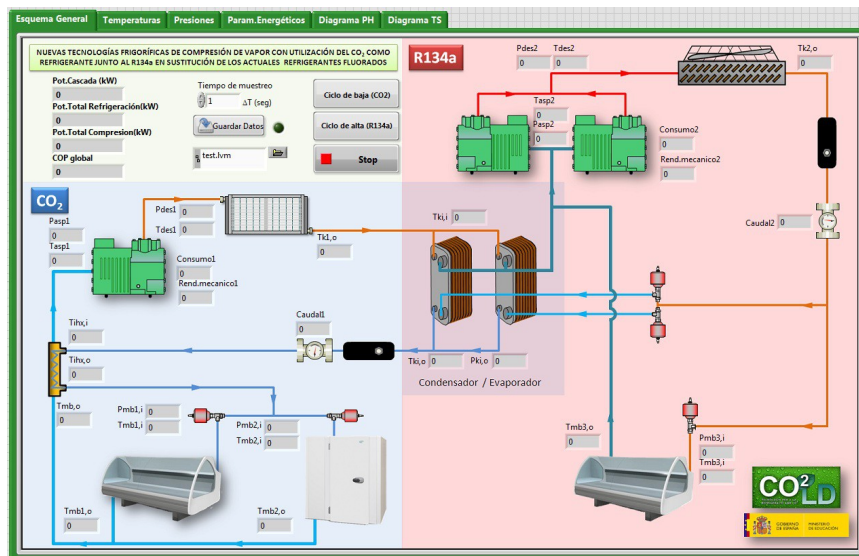


Figure 9. Front end of the DAQ system

- And finally, the last main activity was to launch each cascade facility in each school. This consisted in another process of collaboration, where all the people involved were present and helped with the launching of the plants.



Figure 10. Launching of the cascade refrigeration systems. (Top-left: IES el Valle, Jaén; Top-right: IES Salvador Victoria, Monreal del Campo, Teruel; Bottom-left: IES Pou Clar, Ontinyent, Valencia; Bottom-right: IES Rascanya-Antonio Cañuelo, Valencia)

5 PROJECT RESULTS AND CONCLUSIONS

Although the project has been under way for more than a year and there have been a lot of activities, the main results or conclusions from the project can be summarized as follows:

- The training given to the teachers of Advanced Vocational Training in Refrigeration included the following subjects:
 - Cascade refrigeration plants.
 - Regulation of the compressors of refrigeration plants by using variable-speed drives.
 - Condensing pressure regulation, methods, and energy involvement.
 - Handling and use of fluorinated refrigerants.
 - Defrosting methods in refrigeration plants.
 - Technology of cascade refrigeration systems.
 - Use and applications of CO₂ as a refrigerant.
 - Energy analysis of refrigeration plants. Sensors, data acquisition systems, and data analysis.
 - Energy optimization techniques and control of refrigeration plants.
- About technology transfer from University to the industrial sector: The Thermal Engineering Research Group already had some years of experience in the use of CO₂ as a refrigerant. This knowledge was transferred to the industrial companies and to the teachers and students, mainly based on new refrigeration technologies and new refrigerants.
- About the integration and business collaboration: With the project, a collaborative framework including all the agents involved in refrigeration has been achieved. It extends to cover secondary

school students, the University, the installer companies, and also the manufacturers of refrigeration products. A collaboration forum was created within the framework, where the knowledge flowed from one side to another. And more important, students have been approached by companies in the refrigeration sector.

- And finally, concerning the tangible results, one of the main objectives of the project was to provide the schools with refrigeration plants to be able to practice with them. Furthermore, apart from the plants, a lot of written material has also been created and distributed to the schools, thus enabling them to continue with their training objectives. Moreover, a collaboration platform was set up among the schools, University and companies.

ACKNOWLEDGMENTS

Authors are indebted to the Spanish Ministry of Education, Culture and Sports for the economic help given to the present project (BOE 27/04/2011). Furthermore, all the participants in the project are also grateful to Mr Ignacio Fandos Monfort, promoter and coordinator of the project.

REFERENCES

- Dopazo, J.A., & Fernández-Seara, J. (2011). Experimental evaluation of a cascade refrigeration system prototype with CO₂ and NH₃ for freezing process applications. *International Journal of Refrigeration*, 34(1), 257-267. <http://dx.doi.org/10.1016/j.ijrefrig.2010.07.010>
- European Commission. (2012). COM 643/2012, Proposal for a 'Regulation of the European Parliament and of the Council on Fluorinated Greenhouse gases'.
- Getu, H.M., & Bansal, P.K. (2008) Thermodynamic analysis of an R744–R717 cascade refrigeration system. *International Journal of Refrigeration*, 31, 45-54. <http://dx.doi.org/10.1016/j.ijrefrig.2007.06.014>
- International Institute of Refrigeration. (2007). Refrigeration drives sustainable development. State of the Art - Report Card. IIR/IIF-UNEP.
- McMullan, J.T. (2002) Refrigeration and the environment — issues and strategies for the future. *International Journal of Refrigeration*. 25, 89-99. [http://dx.doi.org/10.1016/S0140-7007\(01\)00007-X](http://dx.doi.org/10.1016/S0140-7007(01)00007-X)
- Mumanachit, P., Reindl, D.T., & Nellis, G.F. (2012) Comparative analysis of low temperature industrial refrigeration systems. *International Journal of Refrigeration*, 35, 1208-1221. <http://dx.doi.org/10.1016/j.ijrefrig.2012.02.009>
- Tassou, S.A., Ge, Y., Hadawey, A., & Marriott, D. (2011). Energy consumption and conservation in food retailing. *Applied Thermal Engineering*, 31, 147–156. <http://dx.doi.org/10.1016/j.applthermaleng.2010.08.023>
- Torrella, E., Llopis, R., & Cabello, R. (2009). Experimental evaluation of the inter-stage conditions of a two-stage refrigeration cycle using a compound compressor. *International Journal of Refrigeration*, 32(2), 307-315. <http://dx.doi.org/10.1016/j.ijrefrig.2008.05.006>
- United Nations. (1997). The Kyoto Protocol to the Framework Convention on Climate Change. 1997. Available at: http://unfccc.int/essential_background/kyoto_protocol/background/items/1351.php

Citation: Sánchez, D., Llopis, R., Patiño, J., Cabello, R., & Torrella E. (2013). CO₂LD: An educational innovation project for Advanced Vocational Training in Refrigeration. *Journal of Technology and Science Education (JOTSE)*, 3(3), 148-156. <http://dx.doi.org/10.3926/jotse.82>

On-line ISSN: 2013-6374 – Print ISSN: 2014-5349 – DL: B-2000-2012

AUTHORS BIOGRAPHY

Ramón Cabello López

Ramon Cabello is Professor in the Department of Mechanical Engineering at the Universitat Jaume I, where he has lectured on Thermal Engineering, Heat Transfer, and Energy Technology since 1998. He received his PhD degree in Applied Thermodynamics from the Polytechnic University of Valencia in 2003. Nowadays his teaching interest is in the improving the energetic efficiency of thermal energy facilities, especially refrigeration ones, and is the supervisor of the Thermal Engineering Research Group (www.git.uji.es). He can be contacted by email at cabello@emc.uji.es.

Rodrigo Llopis Doménech

Rodrigo Llopis, Associate Professor at the Universitat Jaume I of Castellón, is an Industrial Engineer from the Universitat Jaume I and received his PhD from the Polytechnic University of Valencia. He belongs to the Thermal Engineering Research Group (www.git.uji.es) and his lines of research are multi-stage refrigeration plants, natural refrigerants, and infrared thermography. He can be contacted by email at rllopis@uji.es.

Daniel Sánchez García-Vacas

Daniel Sánchez is a lecturer at the Universitat Jaume I of Castellón. He was educated as an Industrial Engineer at the Universitat Jaume I and received his PhD from the same University in 2010. Currently, he belongs to the Thermal Engineering Research Group and his field of interest is the use of natural refrigerants (CO₂ in transcritical conditions) in refrigeration plants for commercial applications. He can be contacted by email at sanchezd@emc.uji.es.

Enrique Torrella Alcaraz

Enrique Torrella is Professor of Thermal Engineering in the Department of Applied Thermodynamics at Polytechnic University of Valencia. His present work involves research on teaching and learning methods in engineering education, especially in Problem-Based Learning (PBL). He can be contacted by email at torrella@ter.upv.es.

Jorge Patiño Pérez

Jorge Patiño is a researcher at the Universitat Jaume I of Castellón. He was educated as an Industrial Engineer at the Universitat Jaume I and received his PhD from this University in 2013. Currently, he belongs to the Thermal Engineering Research Group and his field of interest is the use of natural refrigerants (CO₂ in transcritical conditions) in refrigeration plants for commercial applications. He can be contacted by email at jpatino@uji.es.

Published by OmniaScience (www.omniascience.com)



Journal of Technology and Science Education, 2013 (www.jotse.org)



Article's contents are provided on a Attribution-Non Commercial 3.0 Creative commons license. Readers are allowed to copy, distribute and communicate article's contents, provided the author's and Journal of Technology and Science Education journal's names are included. It must not be used for commercial purposes. To see the complete licence contents, please visit <http://creativecommons.org/licenses/by-nc/3.0/es/>